


SIEMENS

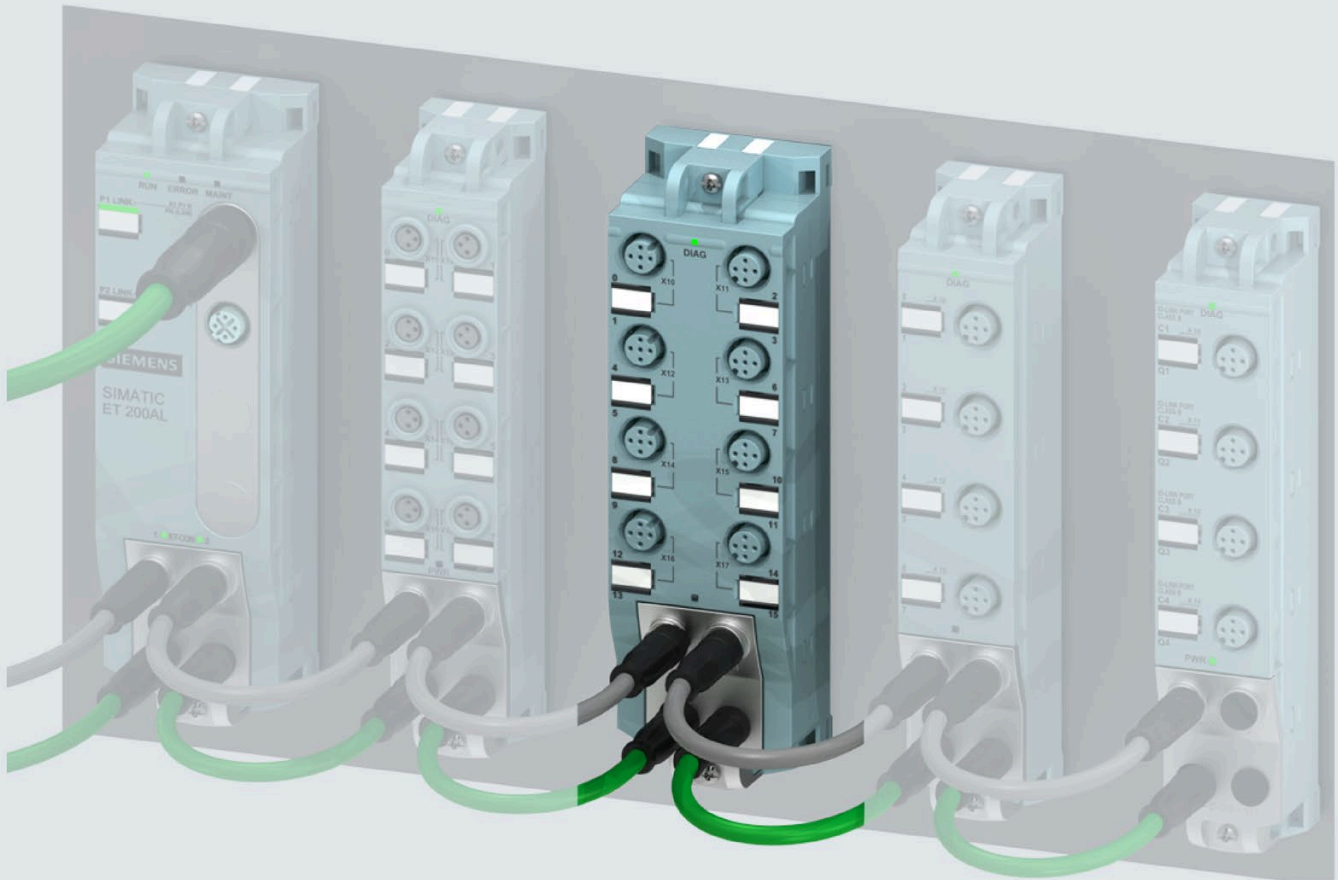

Equipment Manual

SIMATIC

ET 200AL

Digital input module DI 16x24VDC 8xM12
(6ES7141-5AH00-0BA0)

Edition

08/2021

support.industry.siemens.com

SIEMENS

SIMATIC

ET 200AL DI 16x24VDC 8xM12 (6ES7141-5AH00-0BA0)

Equipment Manual

Preface

ET 200AL Documentation
Guide

1

Product overview

2

Wiring

3

Parameters/address space

4

Interrupts/diagnostic
alarms

5

Technical specifications

6

PROFenergy

7




Dimension drawing

A

Legal information

Warning notice system

This manual contains notices you have to observe in order to ensure your personal safety, as well as to prevent damage to property. The notices referring to your personal safety are highlighted in the manual by a safety alert symbol, notices referring only to property damage have no safety alert symbol. These notices shown below are graded according to the degree of danger.

 DANGER
indicates that death or severe personal injury will result if proper precautions are not taken.
 WARNING
indicates that death or severe personal injury may result if proper precautions are not taken.
 CAUTION
indicates that minor personal injury can result if proper precautions are not taken.
NOTICE
indicates that property damage can result if proper precautions are not taken.


If more than one degree of danger is present, the warning notice representing the highest degree of danger will be used. A notice warning of injury to persons with a safety alert symbol may also include a warning relating to property damage.

Qualified Personnel

The product/system described in this documentation may be operated only by **personnel qualified** for the specific task in accordance with the relevant documentation, in particular its warning notices and safety instructions. Qualified personnel are those who, based on their training and experience, are capable of identifying risks and avoiding potential hazards when working with these products/systems.

Proper use of Siemens products

Note the following:

 WARNING
Siemens products may only be used for the applications described in the catalog and in the relevant technical documentation. If products and components from other manufacturers are used, these must be recommended or approved by Siemens. Proper transport, storage, installation, assembly, commissioning, operation and maintenance are required to ensure that the products operate safely and without any problems. The permissible ambient conditions must be complied with. The information in the relevant documentation must be observed.

Trademarks

All names identified by ® are registered trademarks of Siemens AG. The remaining trademarks in this publication may be trademarks whose use by third parties for their own purposes could violate the rights of the owner.

Disclaimer of Liability

We have reviewed the contents of this publication to ensure consistency with the hardware and software described. Since variance cannot be precluded entirely, we cannot guarantee full consistency. However, the information in this publication is reviewed regularly and any necessary corrections are included in subsequent editions.

Preface

Preface

Purpose of the documentation

This manual supplements the ET 200AL distributed I/O system (<https://support.industry.siemens.com/cs/us/en/view/89254965>) system manual. Functions that are generally applicable to the ET 200AL distributed I/O system are described there.

The information provided in the present manual, the system manual and the function manuals enables you to commission the ET 200AL distributed I/O system.

Conventions

Please also observe notes marked as follows:

Note

Indicates important product information to which particular attention should be paid.

Security information

Siemens provides products and solutions with industrial security functions that support the secure operation of plants, systems, machines and networks.

In order to protect plants, systems, machines and networks against cyber threats, it is necessary to implement – and continuously maintain – a holistic, state-of-the-art industrial security concept. Siemens' products and solutions constitute one element of such a concept.

Customers are responsible for preventing unauthorized access to their plants, systems, machines and networks. Such systems, machines and components should only be connected to an enterprise network or the internet if and to the extent such a connection is necessary and only when appropriate security measures (e.g. firewalls and/or network segmentation) are in place.

For additional information on industrial security measures that may be implemented, please visit (<https://www.siemens.com/industrialsecurity>).

Siemens' products and solutions undergo continuous development to make them more secure. Siemens strongly recommends that product updates are applied as soon as they are available and that the latest product versions are used. Use of product versions that are no longer supported, and failure to apply the latest updates may increase customers' exposure to cyber threats.

To stay informed about product updates, subscribe to the Siemens Industrial Security RSS Feed visit (<https://www.siemens.com/industrialsecurity>).


Table of contents

	Preface	3
1	ET 200AL Documentation Guide	5
2	Product overview	9
	2.1 Properties.....	9
	2.2 Operator controls and display elements	11
3	Wiring	12
	3.1 Terminal and block diagram.....	12
	3.2 Pin assignment	13
4	Parameters/address space	16
	4.1 Parameters	16
	4.2 Explanation of the parameters	16
	4.3 Address space.....	17
5	Interrupts/diagnostic alarms	18
	5.1 Status and error displays.....	18
	5.2 Interrupts	20
	5.3 Diagnostics alarms.....	20
6	Technical specifications	21
	6.1 Technical specifications	21
7	PROFenergy	24
	7.1 Pause function.....	24
	7.2 Behavior of the digital input module	25
A	Dimension drawing	26

ET 200AL Documentation Guide

The documentation for the SIMATIC ET 200AL distributed I/O system is arranged into three areas.

This arrangement enables you to access the specific content you require.

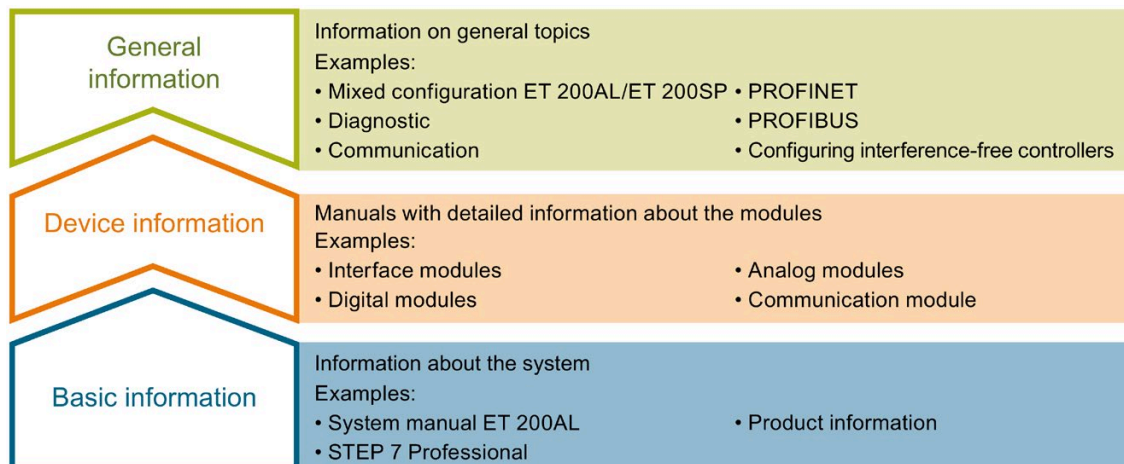

Basic information

The System Manual and Getting Started describe in detail the configuration, installation, wiring and commissioning of the SIMATIC ET 200AL distributed I/O system. The STEP 7 online help supports you in the configuration and programming.

Device information

Product manuals contain a compact description of the module-specific information, such as properties, wiring diagrams, characteristics and technical specifications.

General information

The function manuals contain detailed descriptions on general topics regarding the SIMATIC ET 200AL distributed I/O system, e.g. diagnostics, communication, Motion Control, Web server.

You can download the documentation free of charge from the Internet (<https://support.industry.siemens.com/cs/ww/en/view/109742667>).

Manual Collection ET 200AL

The Manual Collection contains the complete documentation on the SIMATIC ET 200AL distributed I/O system gathered together in one file.

You can find the Manual Collection on the Internet (<https://support.automation.siemens.com/WW/view/en/95242965>).

"mySupport"

With "mySupport", your personal workspace, you make the best out of your Industry Online Support.

In "mySupport", you can save filters, favorites and tags, request CAx data and compile your personal library in the Documentation area. In addition, your data is already filled out in support requests and you can get an overview of your current requests at any time.

You must register once to use the full functionality of "mySupport".

You can find "mySupport" on the Internet (<https://support.industry.siemens.com/My/ww/en>).

"mySupport" - Documentation

With "mySupport", your personal workspace, you make the best out of your Industry Online Support.

In "mySupport", you can save filters, favorites and tags, request CAx data and compile your personal library in the Documentation area. In addition, your data is already filled out in support requests and you can get an overview of your current requests at any time.

You must register once to use the full functionality of "mySupport".

You can find "mySupport" on the Internet (<https://support.industry.siemens.com/My/ww/en/documentation>).

"mySupport" - CAx data

In the CAx data area of "mySupport", you can access the latest product data for your CAx or CAe system.

You configure your own download package with a few clicks.

In doing so you can select:

- Product images, 2D dimension drawings, 3D models, internal circuit diagrams, EPLAN macro files
- Manuals, characteristics, operating manuals, certificates
- Product master data

You can find "mySupport" - CAx data on the Internet (<https://support.industry.siemens.com/my/ww/en/CAxOnline>).

Application examples

The application examples support you with various tools and examples for solving your automation tasks. Solutions are shown in interplay with multiple components in the system - separated from the focus on individual products.

You will find the application examples on the Internet (<https://support.industry.siemens.com/cs/ww/en/ps/ae>).

TIA Selection Tool

With the TIA Selection Tool, you can select, configure and order devices for Totally Integrated Automation (TIA).

This tool is the successor of the SIMATIC Selection Tool and combines the known configurators for automation technology into one tool.

With the TIA Selection Tool, you can generate a complete order list from your product selection or product configuration.

You can find the TIA Selection Tool on the Internet

(<https://support.industry.siemens.com/cs/ww/en/view/109767888>).

SIMATIC Automation Tool

You can use the SIMATIC Automation Tool to perform commissioning and maintenance activities simultaneously on various SIMATIC S7 stations as a bulk operation independent of TIA Portal.

The SIMATIC Automation Tool provides a multitude of functions:

- Scanning of a PROFINET/Ethernet system network and identification of all connected CPUs
- Address assignment (IP, subnet, gateway) and station name (PROFINET device) to a CPU
- Transfer of the date and the programming device/PC time converted to UTC time to the module
- Program download to CPU
- RUN/STOP mode switchover
- CPU localization by means of LED flashing
- Reading out of CPU error information
- Reading of the CPU diagnostics buffer
- Reset to factory settings
- Firmware update of the CPU and connected modules

You can find the SIMATIC Automation Tool on the Internet

(<https://support.industry.siemens.com/cs/ww/en/view/98161300>).

PRONETA

SIEMENS PRONETA (PROFINET network analysis) allows you to analyze the plant network during commissioning. PRONETA features two core functions:

- The topology overview automatically scans the PROFINET and all connected components.
- The IO check is a fast test of the wiring and the module configuration of a plant.

You can find SIEMENS PRONETA on the Internet

(<https://support.industry.siemens.com/cs/ww/en/view/67460624>).

SINETPLAN

SINETPLAN, the Siemens Network Planner, supports you in planning automation systems and networks based on PROFINET. The tool facilitates professional and predictive dimensioning of your PROFINET installation as early as in the planning stage. In addition, SINETPLAN supports you during network optimization and helps you to exploit network resources optimally and to plan reserves. This helps to prevent problems in commissioning or failures during productive operation even in advance of a planned operation. This increases the availability of the production plant and helps improve operational safety.

The advantages at a glance

- Network optimization thanks to port-specific calculation of the network load
- Increased production availability thanks to online scan and verification of existing systems
- Transparency before commissioning through importing and simulation of existing STEP 7 projects
- Efficiency through securing existing investments in the long term and the optimal use of resources

You can find SINETPLAN on the Internet (<https://www.siemens.com/sinetplan>).

Product overview

2.1 Properties

Article number

6ES7141-5AH00-0BA0

View of the module

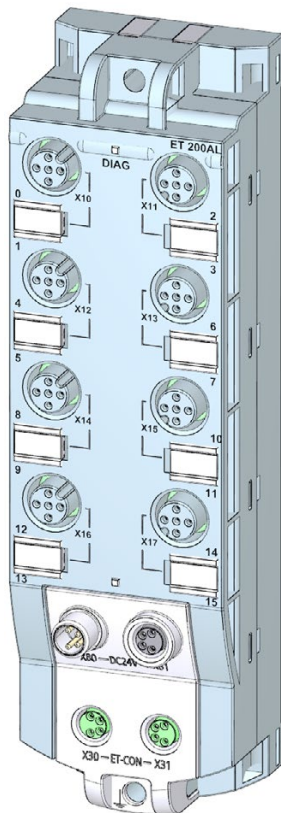


Figure 2-1 View of the DI 16x24VDC 8xM12 digital input module

2.1 Properties

Properties

The module has the following technical properties:

- 16 digital inputs
- M12 sockets for connection of sensors
- 24 V DC supply voltage
- Configurable diagnostics can be set for each module
- Typical input delay of 3 ms
- Suitable for switches and proximity switches
- Dimensions 45 x 159 mm

The module supports the following functions:

- Firmware update
- Identification and maintenance data I&M0 to I&M3
- Value status (Quality Information)
- PROFlenergy

Accessories

The following components are included in the module package:

- Identification labels

Other components

The following component can be ordered as spare part:

- Identification labels

The following components can be ordered as accessories:


- Connectors
- Cables
- Stripping Tool for ET-Connection
- M8 sealing cap
- M12 sealing cap

See also

You can find more information on accessories in the Accessories/spare parts section of the ET 200AL distributed I/O system (<https://support.industry.siemens.com/cs/us/en/view/89254965>) system manual.

2.2 Operator controls and display elements

The figure below shows the operator controls and display elements of the DI 16x24VDC 8xM12 digital input module.

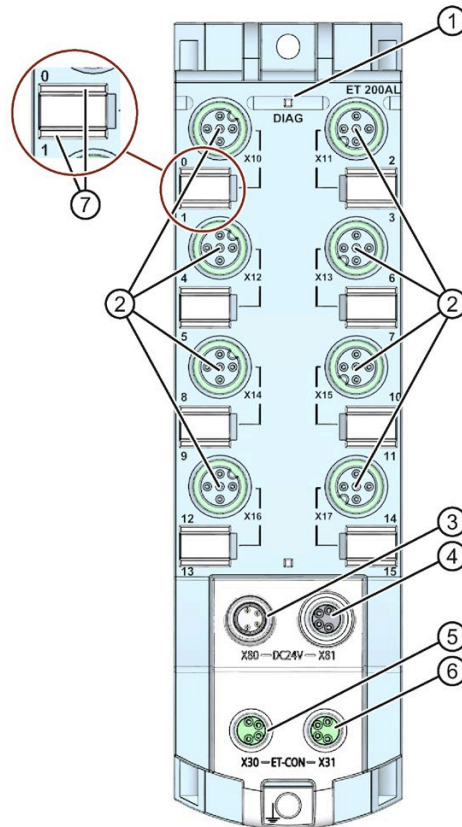


- ① DIAG: LED display for the diagnostic status
- ② X10 to X17: Sockets for the input signal
- ③ X80: Connector for infeed of the supply voltage (POWER input)
- ④ X81: Socket for loop-through of the supply voltage (POWER output)
- ⑤ X30: Socket for ET-Connection IN
- ⑥ X31: Socket for ET-Connection OUT
- ⑦ LED displays 0 to 15 for the channel status

Figure 2-2 Operator controls and display elements

Wiring

3.1 Terminal and block diagram

The figure below shows an example of the pin assignment of signal inputs with 2-wire and 3-wire connection.

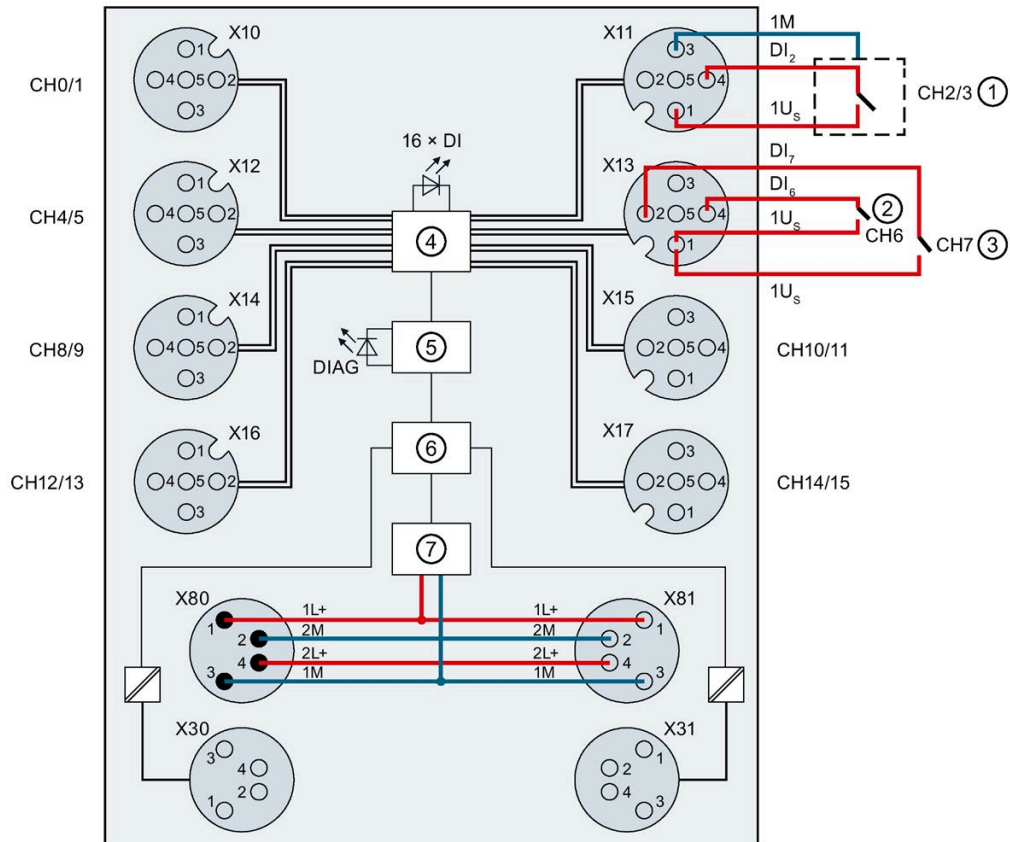

①	3-wire connection	X30	Infeed of the ET-Connection
②	2-wire connection	X31	Loop-through of the ET-Connection
③	2-wire connection	1L+	Supply voltage 1L+ (non-switched)
④	DI circuit	1M	Ground 1M (non-switched)
⑤	Microcontroller	2L+	Load voltage 2L+ (switched)
⑥	ET-Connection interface	2M	Ground 2M (switched)
⑦	Internal supply voltage	1Us	24 V encoder supply
X10 to X17	Channels 0 to 7	DI _n	Input signal
X80	Infeed of supply voltages	DI	Channel status LEDs (0 to 15) (green)
X81	Loop-through of supply voltages	DIAG	LED diagnostic status (red/green)

Figure 3-1 Terminal and block diagram

3.2 Pin assignment

Note



Color coding

The sockets for ET-Connection and the power supply of the modules are color-coded. These colors correspond to the colors of the offered cables.

Pin assignment of the sockets for digital inputs

The table below shows the pin assignment of the 8 sockets for the connection of digital inputs.

Table 3-1 Pin assignment for digital inputs

Pin	Assignment	Front view of the sockets	
		X10, X12, X14, X16	X11, X13, X15, X17
1	24 V encoder supply 1Us (derived from 1L+ non-switched)		
2	Input signal DI1: Connector X10 Input signal DI3: Connector X11 Input signal DI5: Connector X12 Input signal DI7: Connector X13 Input signal DI9: Connector X14 Input signal DI11: Connector X15 Input signal DI13: Connector X16 Input signal DI15: Connector X17		
3	Encoder supply ground 1M		
4	Input signal DI0: Connector X10 Input signal DI2: Connector X11 Input signal DI4: Connector X12 Input signal DI6: Connector X13 Input signal DI8: Connector X14 Input signal DI10: Connector X15 Input signal DI12: Connector X16 Input signal DI14: Connector X17		
5	Functional earth FE		

NOTICE

24 V encoder supply 1Us

Use only the 24 V encoder supply 1Us provided by the digital input module to supply power to the encoder.

3.2 Pin assignment

Pin assignment of the sockets for ET-Connection

The table below shows the pin assignments of the 2 sockets for the connection of ET-Connection.

Table 3-2 Pin assignment for ET-Connection

Pin	Assignment		Assignment of the wire color of the bus line cable for ET-Connection	Front view of the sockets	
	X30 socket (ET-Connection IN)	X31 socket (ET-Connection OUT)		X30	X31
1	TXP	RXP	Yellow		
2	RXP	TXP	White		
3	RXN	TXN	Blue		
4	TXN	RXN	Orange		
Shielding	Functional earth FE		-		

Pin assignment of the connector for infeed of the supply voltage

The table below shows the pin assignment of the connector for infeed of the supply voltage.


Table 3-3 Pin assignment of the supply voltage connector

Pin	Assignment	Assignment of the wire color of the power line cable	Front view of the connector
	X80 connector (POWER input)		
1	Supply voltage 1L+ (non-switched)	Brown	
2	Ground 2M (switched)	White	
3	Ground 1M (non-switched)	Blue	
4	Load voltage 2L+ (switched)	Black	

Pin assignment of the socket for loop-through of the supply voltage

The table below shows the pin assignment of the socket for loop-through of the supply voltage.

Table 3- 4 Pin assignment of the supply voltage socket

Pin	Assignment	Assignment of the wire color of the power line cable	Front view of the socket
	X81 socket (POWER output)		
1	Supply voltage 1L+ (non-switched)	Brown	
2	Ground 2M (switched)	White	
3	Ground 1M (non-switched)	Blue	
4	Load voltage 2L+ (switched)	Black	

NOTICE

ET-Connection/supply voltage

Observe the correct wiring of the M8 sockets for ET-Connection and the supply voltage.

Mixing up the ET-Connection connectors and the connectors for the supply voltage can destroy the module.

Parameters/address space

4.1 Parameters

The table below shows the parameters for the DI 16x24VDC 8xM12 digital input module.

Table 4- 1 Parameters

Parameters	Value range	Default	Scope
Diagnostics: Short-circuit to ground	<ul style="list-style-type: none">• Disable• Enable	Disable	Module

4.2 Explanation of the parameters

Diagnostics: Short-circuit to ground

Enabling of the diagnostics if a short-circuit of the encoder supply to ground occurs.

4.3 Address space

The figure below shows the assignment of the address space for the digital input module DI 16x24VDC 8xM12 with value status (Quality Information, QI).

The address space for the value status is allocated by the module, if the value status is configured using the PROFINET interface module.

Assignment in the process image input (PII)

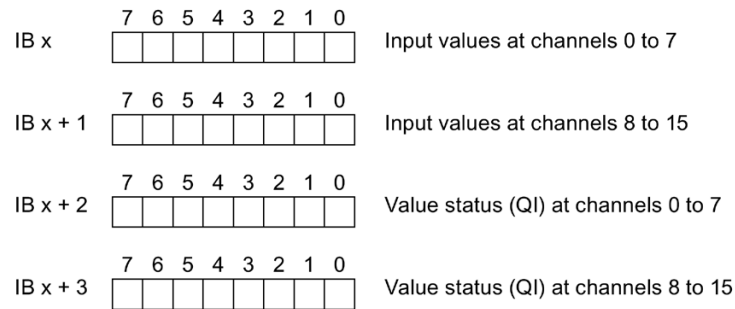


Figure 4-1 Address space

Configuration options of the DI 16x24VDC 8xM12 digital input module

You have the following configuration options:

- Configuration 1: without value status
- Configuration 2: with value status

Evaluating the value status

An additional two bytes are occupied in the input address space if you enable the value status for the digital input module. Bits 0 to 7 in these bytes are assigned to a channel and return information about the validity of the digital input value.

Bit = 1: No error on channel.


Bit = 0: Error on channel.

Interrupts/diagnostic alarms

5.1 Status and error displays

LED displays

The figure below shows the LED displays (status and error displays) of the DI 16x24VDC 8xM12 digital input module.

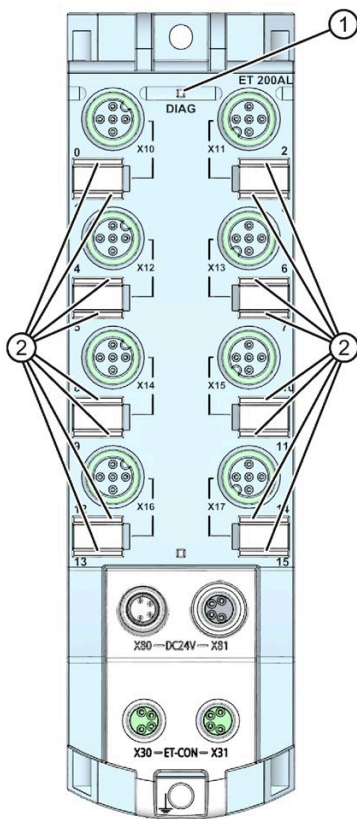

- ① Diagnostic status (DIAG) (red/green)
- ② Channel status (0 to 15) (green)





Figure 5-1 LED displays

Meaning of the LEDs

The following tables set out the meaning of the status and error displays. Corrective measures for diagnostics alarms can be found in section Diagnostics alarms (Page 20).



DIAG LED

Table 5- 1 Error display of the DIAG LED

DIAG LED	Meaning
 Off	No supply voltage 1L+
 Flashes	<ul style="list-style-type: none"> Module parameters not assigned (after switching on the supply voltage 1L+) Loading firmware (while the firmware update is being performed, all LEDs retain their current status) No connection to the ET-Connection and/or the fieldbus
 On	Module parameters assigned and no module diagnostics
 Flashes	Module parameters assigned and module diagnostics

LED channel status

Table 5- 2 LED channel status display

LED channel status	Meaning
 Off	Process signal = 0
 On	Process signal = 1

5.2 Interrupts

The DI 16x24VDC 8xM12 digital input module supports diagnostic interrupts.

Diagnostic interrupt

The digital input module generates a diagnostic interrupt at the following events:

- Short-circuit of encoder supply to ground

5.3 Diagnostics alarms

For each diagnostic event, a diagnostics alarm is issued and the DIAG LED flashes red on the digital input module. You can read out the diagnostics alarms, for example, in the diagnostics buffer of the CPU. You can evaluate the error codes with the user program.

Table 5-3 Diagnostics alarms, their meanings and corrective measures

Diagnosics alarm	Error code	Meaning	Remedy
Short-circuit	1 _H	Short-circuit encoder supply to ground	Eliminate the short-circuit

Technical specifications

6.1 Technical specifications

Technical specifications of the DI 16x24VDC 8xM12 digital input module

The following table shows the technical specifications as of the issue date. You can find a data sheet including daily updated technical specifications on the Internet (<https://support.industry.siemens.com/cs/ww/en/pv/6ES7141-5AH00-0BA0/td?dl=en>).

Article number	6ES7141-5AH00-0BA0
General information	
Product type designation	DI 16x24VDC
HW functional status	FS03
Firmware version	V1.0.x
Product function	
• I&M data	Yes; I&M0 to I&M3
Engineering with	
• STEP 7 TIA Portal configurable/integrated from version	STEP 7 V13 SP1 or higher
• STEP 7 configurable/integrated from version	V5.5 SP4 Hotfix 7 or higher
• PROFIBUS from GSD version/GSD revision	GSD as of Revision 5
• PROFINET from GSD version/GSD revision	GSDML V2.3.1
Supply voltage	
Load voltage 1L+	
• Rated value (DC)	24 V
• permissible range, lower limit (DC)	20.4 V
• permissible range, upper limit (DC)	28.8 V
• Reverse polarity protection	Yes; Against destruction; encoder power supply outputs applied with reversed polarity
Input current	
Current consumption (rated value)	30 mA; without load
from load voltage 1L+ (unswitched voltage)	4 A; Maximum value
from load voltage 2L+, max.	4 A; Maximum value
Encoder supply	
Number of outputs	8
24 V encoder supply	
• Short-circuit protection	Yes; per module, electronic
• Output current, max.	1.4 A; Total current of all encoders

6.1 Technical specifications

Article number	6ES7141-5AH00-0BA0
Power loss	
Power loss, typ.	2.7 W
Digital inputs	
Number of digital inputs	16
Input characteristic curve in accordance with IEC 61131, type 3	Yes
Number of simultaneously controllable inputs all mounting positions	
– up to 55 °C, max.	16
Input voltage	
• Rated value (DC)	24 V
• for signal "0"	-30 to +5 V
• for signal "1"	+11 to +30V
Input current	
• for signal "1", typ.	3.2 mA
Input delay (for rated value of input voltage) for standard inputs	
– at "0" to "1", min.	1.2 ms
– at "0" to "1", max.	4.8 ms
– at "1" to "0", min.	1.2 ms
– at "1" to "0", max.	4.8 ms
Cable length	
• unshielded, max.	30 m
Encoder	
Connectable encoders	
• 2-wire sensor	Yes
– permissible quiescent current (2-wire sensor), max.	1.5 mA
Interrupts/diagnostics/status information	
Alarms	
• Diagnostic alarm	Yes; Parameterizable
Diagnoses	
• Short-circuit	Yes; Sensor supply to M; module by module
Diagnostics indication LED	
• Channel status display	Yes; green LED
• for module diagnostics	Yes; green/red LED
Potential separation	
between the load voltages	Yes

Article number	6ES7141-5AH00-0BA0
Potential separation channels	
• between the channels	No
• between the channels and backplane bus	Yes
• between the channels and the power supply of the electronics	No
Isolation	
Isolation tested with	707 V DC (type test)
Standards, approvals, certificates	
Suitable for safety-related tripping of standard modules	Yes; From FS01
Highest safety class achievable for safety-related tripping of standard modules	
• Performance level according to ISO 13849-1	PL d
• Category according to ISO 13849-1	Cat. 3
• SILCL according to IEC 62061	SILCL 2
Ambient conditions	
Ambient temperature during operation	
• min.	-30 °C
• max.	55 °C
Connection method	
Design of electrical connection for the inputs and outputs	M12, 5-pole
Design of electrical connection for supply voltage	M8, 4-pole
ET-Connection	
• ET-Connection	M8, 4-pin, shielded
Dimensions	
Width	45 mm
Height	159 mm
Depth	40 mm
Weights	
Weight, approx.	184 g

PROFenergy

7.1 Pause function

Introduction

PROFenergy is a PROFINET-based data interface for switching off consumers centrally and in a coordinated manner during pause times regardless of the manufacturer or device type. This has the aim that the process is only provided with the energy that is absolutely required. In so doing, the majority of the energy savings come from the process itself; the PROFINET device contributes only a few watts to the possible savings. In PROFenergy, this operating state is referred to as a "pause".

Start and end of a pause

You enable and disable the pause function of the system at the beginning and end of pauses, respectively; the IO controller then sends the PROFenergy command "Start_Pause" or "End_Pause" to the modules.

Use the "Start_Pause" command to start a pause.

Use the "End_Pause" command to end a pause.

The following conditions will also cause a pause to be ended:

- Reconfiguration in RUN
- Controller failure
- Firmware update
- Station stop
- Restart of the interface module through:
 - POWER OFF/POWER ON of an interface module
 - POWER OFF/POWER ON of an I/O module
 - Termination of ET-Connection1 or ET-Connection2

The specific behavior of the digital input module is explained in the following section.

Additional information

You can find additional information on working with PROFenergy in the "PROFenergy" section of the manual IM 157-1 PN interface module (<https://support.industry.siemens.com/cs/ww/en/view/89254863>) and the "Saving energy with PROFenergy" section of function manual PROFINET with STEP 7 V13 (<https://support.industry.siemens.com/cs/ww/en/view/49948856>).

Application examples (<https://support.industry.siemens.com/cs/ww/en/view/41986454>) are also available on the Internet.

7.2 Behavior of the digital input module

Display

The channel status LEDs are directly influenced by the signal level at the socket. If the encoder supply is switched off, this causes the channel status LEDs to also switch off.

Response to error detection

All channels that are in pause mode on "PE_MODE_PROCEED" report their diagnostic status as in productive mode.

The following applies for all channels which switch to a different pause mode:

- Encoder supply switch-off upon the start of "pause" does not result in the "Short-circuit" alarms.
- During the "pause", error detection of "Short circuit" is not possible:
 - Alarms for errors already pending before the "pause" are retained.
 - After the "pause" is over, the error status is updated and incoming/outgoing errors are reported correspondingly.

Mode parameter

The following table shows the "Mode" parameter.

Table 7- 1 Mode parameter

Element	Code	Explanation
Mode	0b: PE_MODE_PROCEED	Proceed at "pause" • Value status "GOOD"
	1b: PE_MODE_SHUTDOWN	Switch off at "pause" • Encoder supply U_s switched off ¹ • Pause substitute value: 0b • Value status "BAD"
	3b: PE_MODE_LAST_VALUE	Last value at "pause" • Encoder supply U_s switched off ¹ • Pause substitute value: Last input value • Value status "BAD"
	4b: PE_MODE_SUBST_VALUE	Substitute value at "pause" • Encoder supply U_s switched off ¹ • Pause substitute value: Configured pause substitute value • Value status "BAD"

¹ As there is only one encoder supply U_s for all channels, the supply can only be switched off at "pause" if no channel is configured in PE_MODE_PROCEED.

Dimension drawing

The figure below shows the dimension drawing of the DI 16x24VDC 8xM12 digital input module in front and side view.

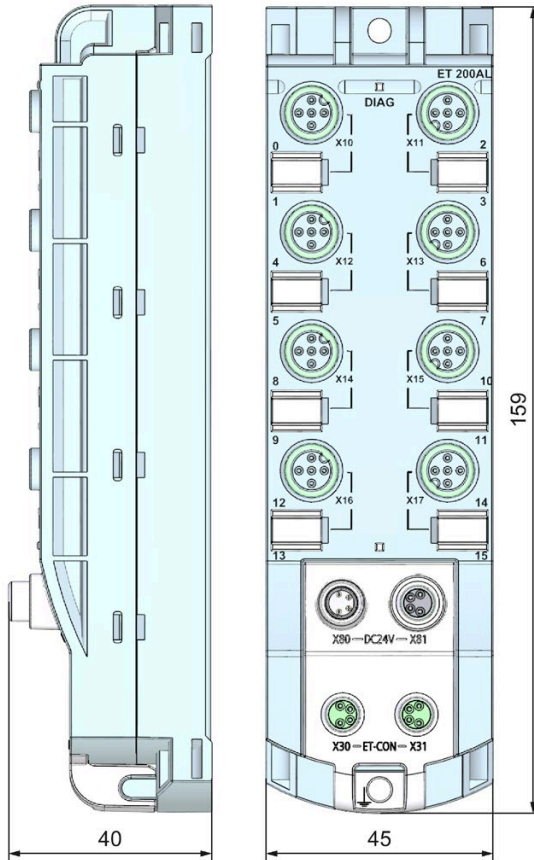


Figure A-1 Dimension drawing