

# Process Pump

## PA3000/5000 Series

Automatically Operated Type (Internal Switching Type)/Air Operated Type (External Switching Type)

RoHS



PA

PA(P)

PAX

PB

PAF

PA   
PB

### High abrasion resistance and low particle generation

No sliding parts in wetted areas.

### Self-priming makes priming unnecessary

Exhausts the air inside the suction pipe to suck up liquid.

#### Automatically operated type




Compatible with a wide variety of fluids

- PA3000: Max. discharge rate 20 L/min
- PA5000: Max. discharge rate 45 L/min

#### Air operated type


Control with external switching valve makes constant cycling possible

- Easily control the discharge rate. Easily adjust the flow with the external solenoid valve's ON/OFF cycle.
- Easy to operate, even for minute flow, low press operation or operation involving air.
- Can be used for operation with repetitive stopping.

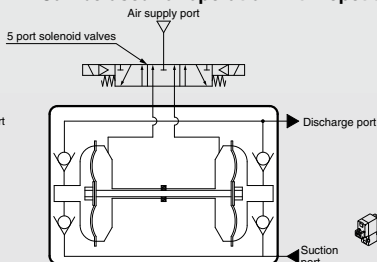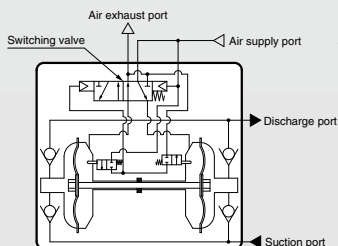


#### Application Example


Transferring liquid by suction




Atomizing liquid



Transferring liquid by pressure



Stirring liquid



• Prevents sticking of liquids

# Process Pump

## Automatically Operated Type (Internal Switching Type)

## Air Operated Type (External Switching Type)

# PA3000 Series

RoHS

### How to Order



PA 3 1 1 0 - 03 -

#### Material of body wetted areas

Symbol	Material of body wetted areas
1	ADC12 (Aluminum)
2	SCS14 (Stainless steel)

#### Diaphragm material

Symbol	Diaphragm material	Applicable actuation	
		Automatically operated	Air operated
1	PTFE	●	●
2	NBR	●	—

#### Actuation

Symbol	Actuation
0	Automatically operated
3	Air operated

#### Option

Symbol	Option	Applicable actuation	
		Automatically operated	Air operated
NII	Body only	●	●
N	With silencer*	●	—

\* For AIR EXH: AN20-□02  
(□: Either Nil or N is entered as a thread symbol.)



#### Port size

Symbol	Port size
03	3/8"

#### Thread type

Symbol	Type
Nil	Rc
N	NPT
F	G
T	NPTF

#### Symbol



### Specifications

Model	PA3110	PA3120	PA3210	PA3220	PA3113	PA3213	
<b>Actuation</b>	Automatically operated				Air operated		
<b>Port size</b>	Main fluid suction/discharge port Rc, NPT, G, NPTF 3/8" Female thread						
	Pilot air supply/exhaust port Rc, NPT, G, NPTF 1/4" Female thread						
<b>Material</b>	Body wetted areas		ADC12		SCS14		
	Diaphragm		PTFE, NBR		ADC12, SCS14		
Check valve		PTFE, PFA				PTFE	
<b>Discharge rate</b>	1 to 20 L/min				0.1 to 12 L/min		
<b>Average discharge pressure</b>	0 to 0.6 MPa				0 to 0.4 MPa		
<b>Pilot air pressure</b>	0.2 to 0.7 MPa				0.1 to 0.5 MPa		
<b>Air consumption</b>	Max. 200 L/min (ANR) or less				Max. 150 L/min (ANR) or less		
<b>Suction lifting range</b>	Dry						
	Wet						
Dry		1 m (Interior of pump dry)				72 dB (A) or less	
Wet		Up to 6 m (liquid inside pump)				(excluding the noise from the quick exhaust and solenoid valve)	
<b>Noise</b>	80 dB (A) or less (Option: with silencer, AN20)				72 dB (A) or less (excluding the noise from the quick exhaust and solenoid valve)		
<b>Withstand pressure</b>	1.05 MPa				0.75 MPa		
<b>Diaphragm life</b>	100 million times	50 million times	100 million times	50 million times	50 million times		
<b>Fluid temperature</b>	0 to 60°C (No freezing)						
<b>Ambient temperature</b>	0 to 60°C (No freezing)						
<b>Maximum viscosity</b>	1000 mPa·s						
<b>Recommended operating cycle</b>	—				1 to 7 Hz (0.2 to 1 Hz also possible depending on conditions) <sup>Note 2)</sup>		
<b>Pilot air solenoid valve recommended Cv factor</b>	—				0.20		
<b>Weight</b>	1.7 kg		2.2 kg		1.7 kg	2.2 kg	
<b>Mounting orientation</b>	Horizontal (with mounting foot at bottom)						
<b>Packaging</b>	General environment						

\* Each of the values above are for normal temperatures and when the transferred fluid is fresh water.

\* Refer to page 558 for maintenance parts.

\* For related products, refer to pages 622 and 623.

Note 1) With cycles at 2 Hz or more

Note 2) After initial suction of liquid operating at 1 to 7 Hz, it can be used with operation at lower cycles.

Since a large quantity of liquid will be pumped out, use a suitable throttle in the discharge port if problems occur.

Note 3) With a low number of operating cycles, even a valve with a small Cv factor can be operated.



**Made to order specifications**  
(For details, refer to pages 563 and 564)

Products complying with ATEX
With air operated reset port <sup>Note)</sup>
With operating cycle counting port <sup>Note)</sup>

Note) For automatically operated type only.

# Process Pump

## Automatically Operated Type (Internal Switching Type)

## Air Operated Type (External Switching Type)

# PA5000 Series

RoHS

PA  
PA(P)  
PAX  
PB  
PAF  
PA□  
PB

### How to Order



PA 5 1 1 0 - 04 -

#### Material of body wetted areas

Symbol	Material of body wetted areas
1	ADC12 (Aluminum)
2	SCS14 (Stainless steel)

#### Diaphragm material

Symbol	Diaphragm material	Applicable actuation	
		Automatically operated	Air operated
1	PTFE	●	●
2	NBR	●	—

#### Actuation

Symbol	Actuation
0	Automatically operated
3	Air operated

#### Option

Symbol	Option	Applicable actuation	
		Automatically operated	Air operated
Nil	Body only	●	●
N	With silencer*	●	—

\* For AIR EXH: AN20□02  
 (□: Either Nil or N is entered as a thread symbol.)



#### Port size

Symbol	Port size
04	1/2"
06	3/4"

#### Thread type

Symbol	Type
Nil	Rc
N	NPT
F	G
T	NPTF

#### Symbol



### Specifications

Model	PA5110	PA5120	PA5210	PA5220	PA5113	PA5213
<b>Actuation</b>	Automatically operated				Air operated	
<b>Port size</b>	Main fluid suction/discharge port Rc, NPT, G, NPTF 1/2", 3/4" Female thread					
	Pilot air supply/exhaust port Rc, NPT, G, NPTF 1/4" Female thread					
<b>Material</b>	Body wetted areas ADC12 SCS14 ADC12 SCS14					
	Diaphragm PTFE NBR		PTFE NBR		PTFE	
Check valve PTFE, PFA						
<b>Discharge rate</b>	5 to 45 L/min				1 to 24 L/min	
<b>Average discharge pressure</b>	0 to 0.6 MPa				0 to 0.4 MPa	
<b>Pilot air pressure</b>	0.2 to 0.7 MPa				0.1 to 0.5 MPa	
<b>Air consumption</b>	Max. 300 L/min (ANR) or less				Max. 250 L/min (ANR) or less	
<b>Suction lifting range</b> <small>Note 1)</small>	Dry Up to 2 m (Interior of pump dry)				Up to 0.5 m (Interior of pump dry)	
	Wet Up to 6 m (Liquid inside pump)					
<b>Noise</b>	78 dB (A) or less (Option: with silencer, AN 20)				72 dB (A) or less (excluding the noise from the quick exhaust and solenoid valve)	
<b>Withstand pressure</b>	1.05 MPa				0.75 MPa	
<b>Diaphragm life</b>	50 million times					
<b>Operating fluid temperature</b>	0 to 60°C (No freezing)					
<b>Ambient temperature</b>	0 to 60°C (No freezing)					
<b>Maximum viscosity</b>	1000 mPa·s					
<b>Recommended operating cycle</b>	—				1 to 7 Hz (0.2 to 1 Hz also possible depending on conditions) <small>Note 2)</small>	
<b>Pilot air solenoid valve recommended Cv factor</b> <small>Note 3)</small>	—				0.45	
<b>Weight</b>	3.5 kg		6.5 kg		3.5 kg	6.5 kg
<b>Mounting orientation</b>	Horizontal (with mounting foot at bottom)					
<b>Packaging</b>	General environment					



**Made to order specifications**  
 (For details, refer to pages 563 and 564)

Products complying with ATEX
With air operated reset port <sup>Note)</sup>
With operating cycle counting port <sup>Note)</sup>

Note) For automatically operated type only.

\* Each of the values above are for normal temperatures and when the transferred fluid is fresh water.  
 \* Refer to page 558 for maintenance parts.  
 \* For related products, refer to pages 622 and 623.

Note 1) With cycles at 2 Hz or more

Note 2) After initial suction of liquid operating at 1 to 7 Hz, it can be used with operation at lower cycles.


Since a large quantity of liquid will be pumped out, use a suitable throttle in the discharge port if problems occur.

Note 3) With a low number of operating cycles, even a valve with a small Cv factor can be operated.




## Performance Curve: Automatically Operated Type

### PA3□□0 Flow Rate Characteristics

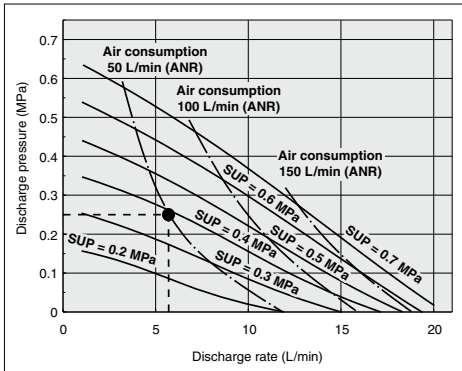

### PA5□□0 Flow Rate Characteristics

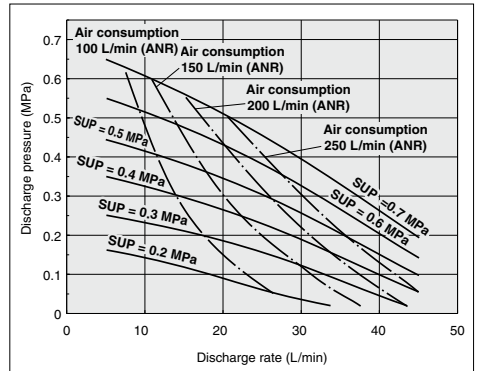

### Selection from Flow Rate Characteristic Graph (PA3□□0)

Required specifications example:

Find the pilot air pressure and pilot air consumption for a discharge rate of 6 L/min and a discharge pressure of 0.25 MPa. <The transfer fluid is fresh water (viscosity 1 mPa·s, specific gravity 1.0).>

\* If the total lifting height is required instead of the discharge pressure, a discharge pressure of 0.1 MPa corresponds to a total lift of 10 m.


Selection procedures:

1. First mark the intersection point for a discharge rate of 6 L/min and a discharge pressure of 0.25 MPa.
2. Find the pilot air pressure for the marked point. In this case, the point is between the discharge curves (solid lines) for SUP = 0.3 MPa and SUP = 0.4 MPa, and based on the proportional relationship to these lines, the pilot air pressure for this point is approximately 0.38 MPa.
3. Next find the air consumption rate. Since the marked point is below the curve for 50 L/min (ANR), the maximum rate will be about 50 L/min (ANR).

### ⚠ Caution

1. These flow rate characteristics are for fresh water (viscosity 1 mPa·s, specific gravity 1.0).
2. The discharge rate differs greatly depending on properties (viscosity, specific gravity) of the fluid being transferred and operating conditions (lifting range, transfer distance), etc.
3. Use 0.75 kW per 100 L/min of air consumption as a guide for the relationship of the air consumption to the compressor.

### Viscosity Characteristics (Flow rate correction for viscous fluids)

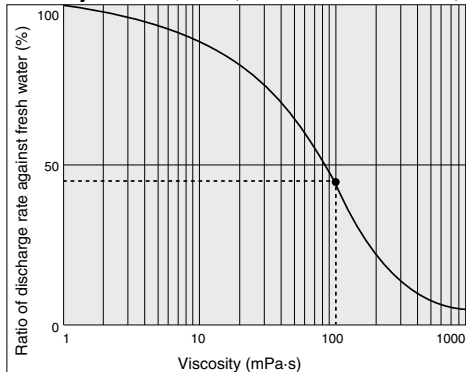

### Selection from Viscosity Characteristic Graph

Required specifications example:

Find the pilot air pressure and pilot air consumption for a discharge rate of 2.7 L/min, and a viscosity of 100 mPa·s.

Selection procedures:

1. First find the ratio of the discharge rate for fresh water when viscosity is 100 mPa·s from the graph below. It is determined to be 45%.
2. Next, in the required specification example, the viscosity is 100 mPa·s and the discharge rate is 2.7 L/min. Since this is equivalent to 45% of the discharge rate for fresh water,  $2.7 \text{ L/min} \div 0.45 = 6 \text{ L/min}$ , indicating that a discharge rate of 6 L/min is required for fresh water.
3. Finally, find the pilot air pressure and pilot air consumption based on selection from the flow characteristic graphs.

### ⚠ Caution


Viscosities up to 1000 mPa·s can be used.  
Dynamic viscosity  $\nu$  = Viscosity  $\mu$ /Density  $\rho$ .

$$\nu = \frac{\mu}{\rho}$$


$$\nu(10^{-3} \text{ m}^2/\text{s}) = \mu(\text{mPa}\cdot\text{s})/\rho(\text{kg}/\text{m}^3)$$

**Performance Curve: Air Operated Type**

**PA3□13 Flow Rate Characteristics**

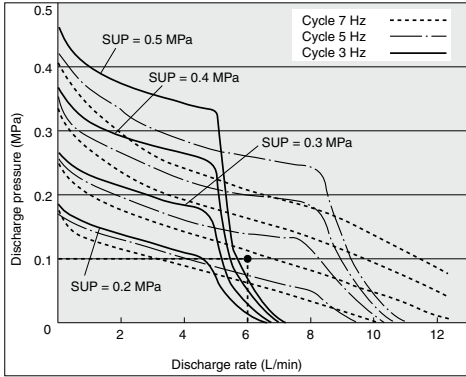


**PA5□13 Flow Rate Characteristics**

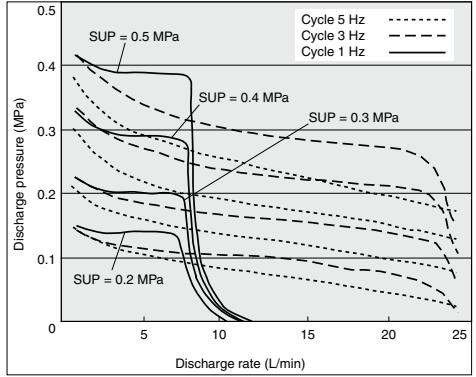


PA
PA(P)
PAX
PB
PAF
PA□
PB


**PA3□13 Air Consumption**

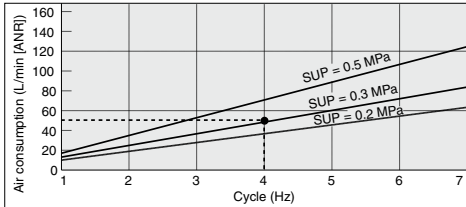

**PA5□13 Air Consumption**

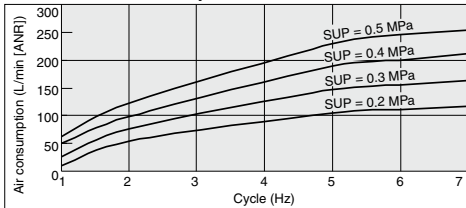

**Viscosity Characteristics (Flow rate correction for viscous fluids)**

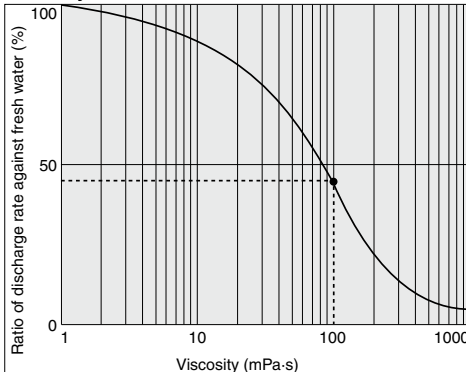

**Selection from Flow Rate Characteristic Graph (PA3□13)**

Required specification example: Find the pilot air pressure and pilot air consumption for a discharge rate of 6 L/min. <The transfer fluid is fresh water (viscosity 1 mPa-s, specific gravity 1.0).>

Note 1) If the total lifting height is required instead of the discharge pressure, a discharge pressure of 0.1 MPa corresponds to a total lift of 10 m.

Selection procedures:

1. First mark the intersection point for a discharge rate of 6 L/min and a discharge pressure of 0.1 MPa.
2. Find the pilot air pressure for the marked point. In this case, the point is between the discharge curves (solid lines) for SUP = 0.2 MPa and SUP = 0.3 MPa, and based on the proportional relationship to these lines, the pilot air pressure for this point is approximately 0.25 MPa.

**⚠ Caution**

1. These flow rate characteristics are for fresh water (viscosity 1 mPa-s, specific gravity 1.0).
2. The discharge rate differs greatly depending on properties (viscosity, specific gravity) of the fluid being transferred and operating conditions (density, lifting range, transfer distance).

**Calculating Air Consumption (PA3□13)**

Find the air consumption for operation with a 4 Hz switching cycle and pilot air pressure of 0.3 MPa from the air consumption graph.

Selection procedures:

1. Look up from the 4 Hz switching cycle to find the intersection with SUP = 0.3 MPa.
2. From the point just found, draw a line to the Y-axis to find the air consumption. The result is approximately 50 L/min (ANR).

**Selection from Viscosity Characteristic Graph**

Required specification example: Find the pilot air pressure and pilot air consumption for a discharge rate of 2.7 L/min, and a viscosity of 100 mPa-s.

Selection procedures:

1. First find the ratio of the discharge rate for fresh water when viscosity is 100 mPa-s from the graph below. It is determined to be 45%.
2. Next, in the required specification example, the viscosity is 100m Pa-s and the discharge rate is 2.7 L/min. Since this is equivalent to 45% of the discharge rate for fresh water,  $2.7 \text{ L/min} \div 0.45 = 6 \text{ L/min}$ , indicating that a discharge rate of 6 L/min is required for fresh water.
3. Finally, find the pilot air pressure and pilot air consumption based on selection from the flow characteristic graphs.

**⚠ Caution**


Viscosities up to 1000 mPa-s can be used.  
Dynamic viscosity  $v = \text{Viscosity } \mu / \text{Density } \rho$ .

$$v = \frac{\mu}{\rho}$$

$$v(10^{-3} \text{ m}^2/\text{s}) = \mu(\text{mPa-s})/\rho(\text{kg/m}^3)$$

## Working Principle

### Automatically Operated Type

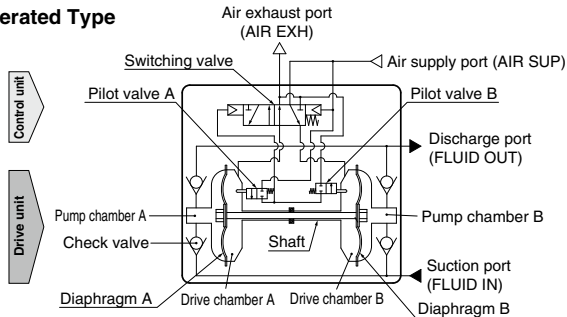


#### Control unit

1. When air is supplied, it passes through the switching valve and enters drive chamber B.
2. Diaphragm B moves to the right, and at the same time diaphragm A also moves to the right pushing pilot valve A.
3. When pilot valve A is pushed, air acts upon the switching valve, drive chamber A switches to a supply state, and the air which was in drive chamber B is exhausted to the outside.
4. When air enters drive chamber A, diaphragm B moves to the left pushing pilot valve B.
5. When pilot valve B is pushed, the air which was acting upon the switching valve is exhausted, and drive chamber B once again switches to a supply state. A continuous reciprocal motion is generated by this repetition.

#### Drive unit

1. When air enters drive chamber B, the fluid in pump chamber B is forced out, and at the same time fluid is sucked into pump chamber A.
2. When the diaphragm moves in the opposite direction, the fluid in pump chamber A is forced out, and fluid is sucked into pump chamber B.
3. Continuous suction and discharge is performed by the reciprocal motion of the diaphragm.

### Air Operated Type

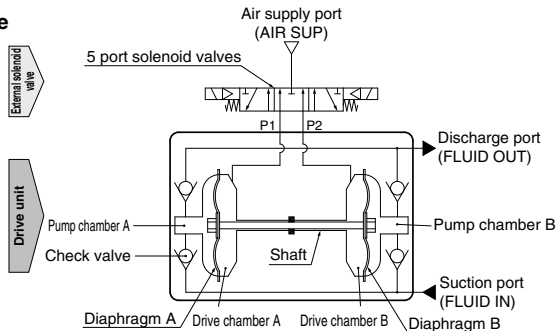

1. When air is supplied to P1 port, it enters drive chamber A.
2. Diaphragm A moves to the left, and at the same time diaphragm B also moves to the left.
3. The fluid in pump chamber A is forced out to the discharge port, and the fluid is sucked into pump chamber B from the suction port.
4. If air is supplied to the P2 port, the opposite will occur. Continuous suction and discharge of fluid is performed by repeating this process with the control of an external solenoid valve (5 port valve).

## Maintenance Parts

- Basically, it is not recommended to disassemble the process pump. However, if this is necessary, be sure to follow the instructions in the maintenance procedure.
- When carrying out this work, wear appropriate protective equipment.


### PA3000/5000 Series

Description	PA3000 series			PA5000 series		
	PA3□10	PA3□20	PA3□13	PA5□10	PA5□20	PA5□13
Diaphragm kit	KT-PA3-31	KT-PA3-32	KT-PA3-31	KT-PA5-31	KT-PA5-32	KT-PA5-31
Check valve kit	KT-PA3-36			KT-PA5-36		
Switching valve assembly kit	KT-PA3-37□ (Note)			—		
Switching valve parts kit	—			KT-PA5-37		
Pilot valve kit	KT-PA5-38			—		
Manual cap assembly kit	KT-PA3-45			—		

Note) One of Nil, N, F or T is entered as a thread symbol.

## Piping and Operation: Automatically Operated Type

### Piping diagram

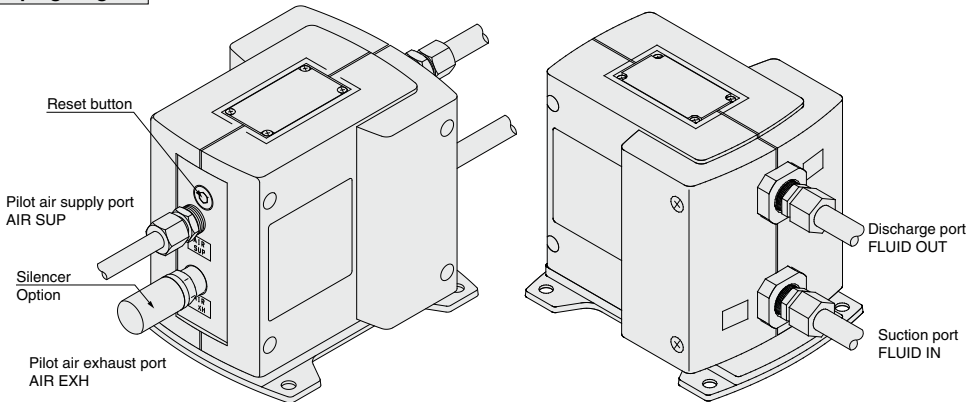

PA
PA(P)
PAX
PB
PAF
PA□
PB

### ⚠ Caution

Mounting posture of the pump is set with the mounting bracket facing downward. Air to be supplied to the air supply port <AIR SUP> should be cleaned and filtered through AF filter, etc. Air with foreign matter or drainage etc. will have negative effects on the built-in directional control valve and will lead to malfunction. When air needs additional purification, use a filter (AF series), and a mist separator (AM series) together.

Maintain the proper tightening torque for fittings and mounting bolts, etc. Looseness can cause problems such as fluid and air leaks, while over tightening can cause damage to threads and parts, etc.

### Operation

<Starting and Stopping> Refer to circuit example (1)

1. Connect air piping to the air supply port <AIR SUP> and connect piping for the fluid to be transferred to the suction port <FLUID IN> and the discharge port <FLUID OUT>.
  2. Using a regulator, set the pilot air pressure within the range of 0.2 to 0.7 MPa. Then, the pump operates when power is applied to the 3 port solenoid valve of the air supply port <AIR SUP>, the sound of exhaust begins from the air exhaust port <AIR EXH> and fluid flows from the suction port <FLUID IN> to the discharge port <FLUID OUT>.
- At this time, the throttle on the discharge side is in an open state. The pump performs suction with its own power even without priming. (Dry state suction lifting range: max. 1 m) To restrict exhaust noise, attach a silencer (AN20-02: option) to the air exhaust port <AIR EXH>.
3. To stop the pump, exhaust the air pressure being supplied to the pump by the 3 port solenoid valve of the air supply port <AIR SUP>. The pump will also stop if the throttle on the discharge side is closed.


<Discharge Flow Rate Adjustment>

1. To adjust the flow rate from the discharge port <FLUID OUT>, use the throttle connected to the discharge side. Refer to circuit example (1). Note that this product cannot be used as a fixed quantity liquid dispense pump.
2. When operating with a discharge flow rate below the specification range, provide a by-pass circuit from the discharge side to the suction side to ensure the minimum flow rate inside the process pump. With a discharge flow rate below the minimum flow rate, the process pump may stop due to unstable operation. Refer to circuit example (2). (Minimum flow rates: PA3000 1 L/min, PA5000 5 L/min)

<Reset Button>


When the pump stops during operation, press the reset button. This makes it possible to restore operation in case the switching valve becomes clogged due to foreign matter in the supply air.

### Circuit example (1)

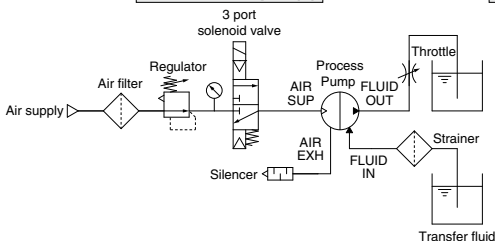


### Circuit example (2)

For related products, refer to pages 622 and 623.



## Piping and Operation: Air Operated Type

### Piping diagram

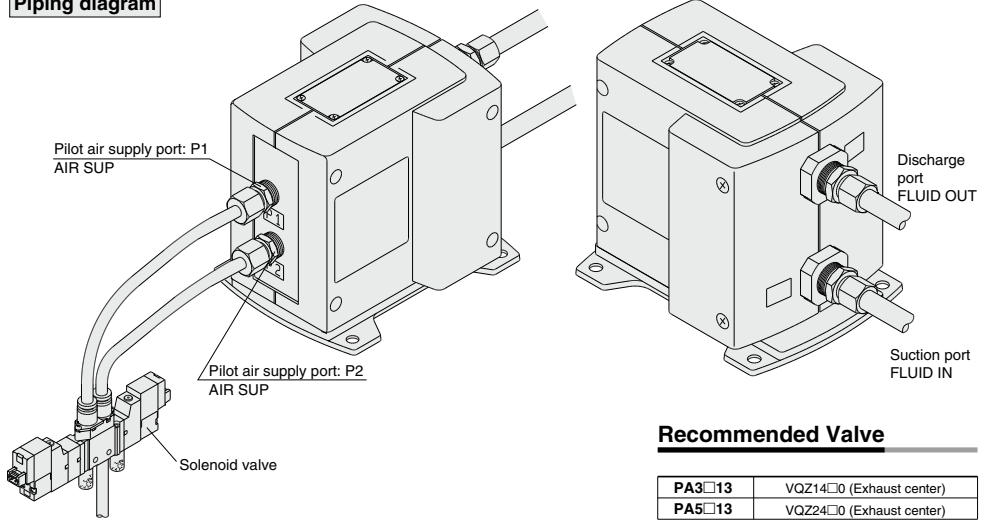

### Recommended Valve

PA3□13	VQZ14□0 (Exhaust center)
PA5□13	VQZ24□0 (Exhaust center)

### ⚠ Caution

Maintain the proper tightening torque for fittings and mounting bolts, etc. Looseness can cause problems such as fluid and air leaks, while over tightening can cause damage to threads and parts, etc.

### Operation

<Starting and Stopping> Refer to circuit example

1. Connect air piping <sup>Note 1)</sup> to the pilot air supply port <P1>, <P2> and connect piping for the fluid to be transferred to the suction port <FLUID IN> and the discharge port <FLUID OUT>.
2. Using a regulator, set the pilot air pressure within the range of 0.1 to 0.5 MPa. Then, the pump operates when power is applied to the solenoid valve <sup>Note 2)</sup> of the pilot air supply port and fluid flows from the suction port <FLUID IN> to the discharge port <FLUID OUT>. At this time, the throttle on the discharge side is in an open state. The pump performs suction with its own power even without priming. (Dry state suction lifting range: PA3 1 m, PA5 up to 0.5 m <sup>Note 3)</sup>) To restrict exhaust noise, attach a silencer to the solenoid valve air exhaust port.
3. To stop the pump, exhaust the air pressure being supplied to the pump with the solenoid valve of the air supply port.

Note 1) When used for highly permeable fluids, the solenoid valve may malfunction due to the gas contained in the exhaust. Implement measures to keep the exhaust from going to the solenoid valve side.


Note 2) For the solenoid valve, use an exhaust center 5 port valve, or a combination of residual exhaust 3 port valve and a pump drive 4 port valve. If air in the drive chamber is not released when the pump is stopped, the diaphragm will be subjected to pressure and its life will be shortened.

Note 3) When the pump is dry, operate the solenoid valve at a switching cycle of 1 to 7 Hz. If operated outside of this range, the suction lifting height may not reach the prescribed value.

<Discharge Flow Rate Adjustment>


1. The flow rate from the discharge port <FLUID OUT> can be adjusted easily by changing the switching cycle of the solenoid valve on the air supply port.

### Circuit example (1)

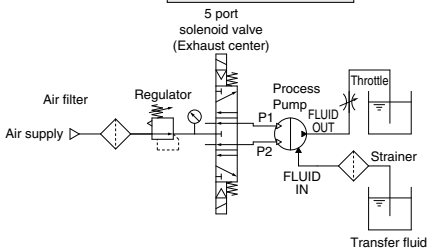

### Circuit example (2)


For related products, refer to pages 622 and 623.

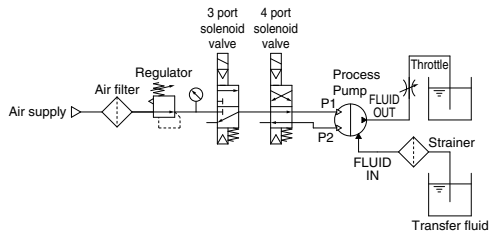




**Dimensions**

**PA3□□0/Automatically Operated Type**

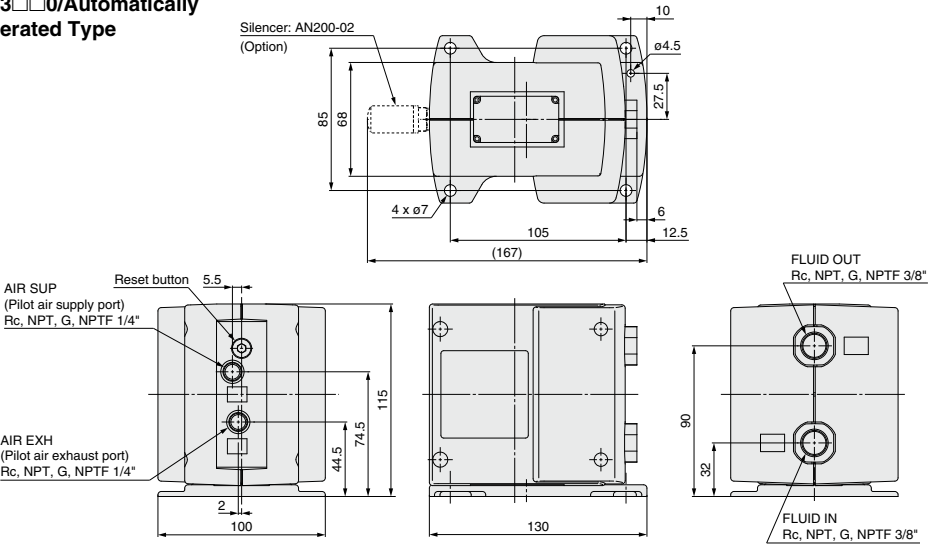


<b>PA</b>
PA(P)
<b>PAX</b>
<b>PB</b>
<b>PAF</b>
PA□
PB

**PA3□13/Air Operated Type**

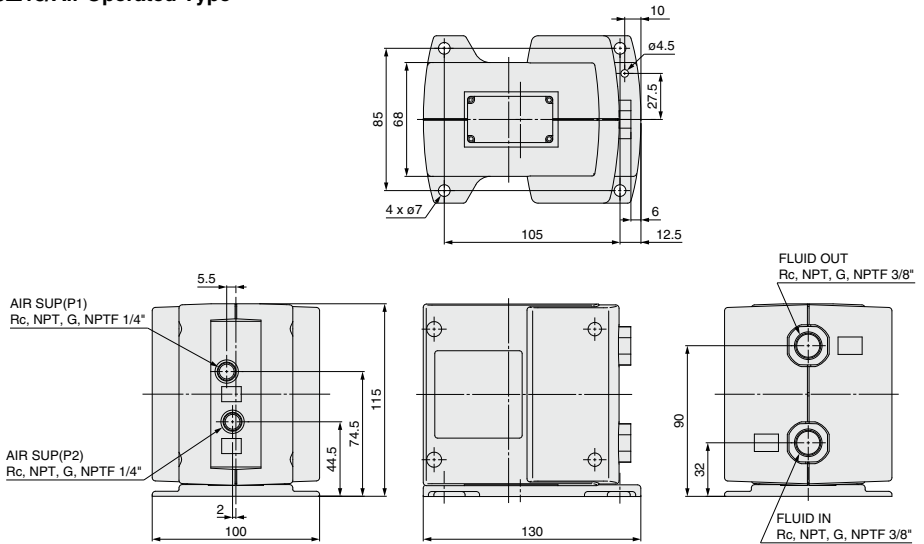


## Dimensions

### PA5□□0/Automatically Operated Type

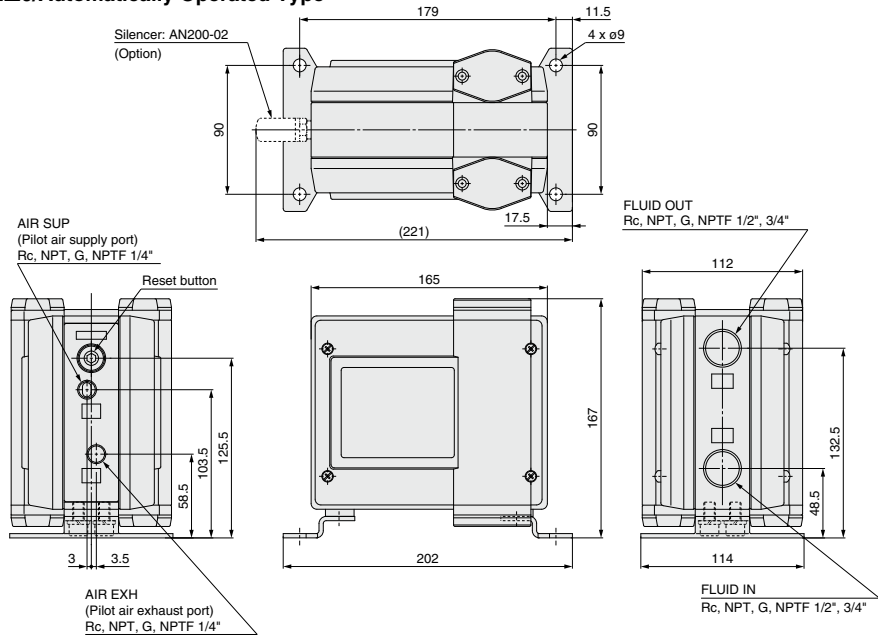

### PA5□13/Air Operated Type

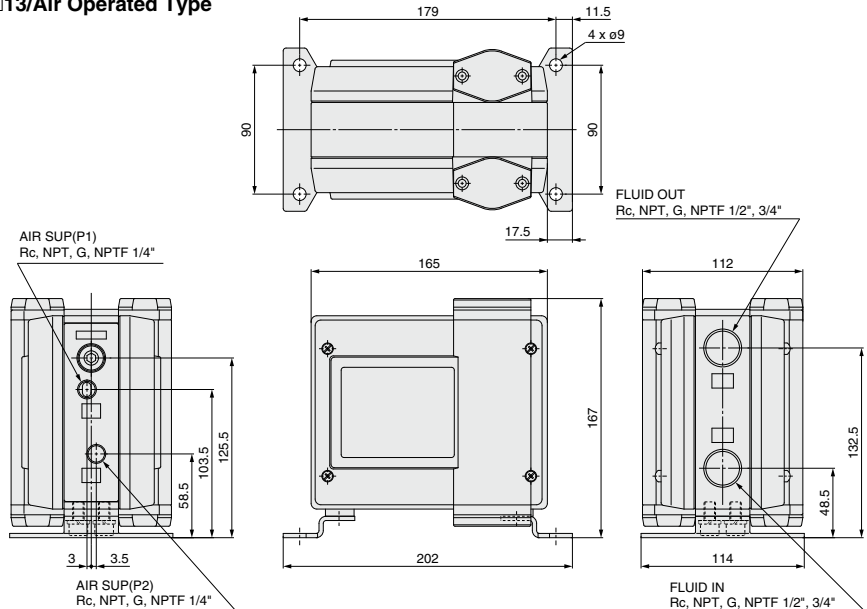



## ● PA3000/5000 Series

### 1. Products Complying with ATEX

55-PA 3 1 1 0 - 03 -

#### Products complying with the ATEX Directive

55	Products complying with the ATEX Directive, Category 2
56	Products complying with the ATEX Directive, Category 3

#### Body size

Symbol	Body size
3	3/8"
5	1/2"

#### Wetted body material

Symbol	Body material
1	ADC12 (Aluminum)
2	SCS14 (Stainless steel)

#### Diaphragm material

Symbol	Diaphragm material	Operating method	
		Automatically operated	Air operated
1	PTFE	●	●
2	NBR	●	—

\* Dimensions are the same as those of the standard products.

#### Actuation

Symbol	Actuation
0	Automatic operation
3	Air operated

#### Option

Symbol	Option	Operating method	
		Automatically operated	Air operated
Nil	None	●	●
N	With silencer*	●	—

\* This product is equipped with a 2504-002 (NPT: 2504-N002) silencer.

\* For AIR EXH

55-PA: 2504-□002

56-PA: AN20-□02

(□: Either Nil or N is entered as a thread symbol.)

#### Port size

Symbol	Port size	Applicable model	
		PA3000	PA5000
03	3/8"	●	—
04	1/2"	—	●
06	3/4"	—	●

#### Thread type

Symbol	Type
Nil	Rc
N	NPT
F	G
T	NPTF

PA

PA(P)

PAX

PB

PAF

PA□

PB

# PA3000/5000 Series

## 2. With Air Operated Reset Port

PA **3** **1** **1** **0** - **03** - **X2**

**Body size**

Symbol	Body size
3	3/8"
5	1/2"

**Wetted body material**

Symbol	Body material
1	ADC12 (Aluminum)
2	SCS14 (Stainless steel)

**Diaphragm material**

Symbol	Diaphragm material
1	PTFE
2	NBR

**Thread type**

Symbol	Type
Nil	Rc
N	NPT
F	G
T	NPTF

**Option**


Symbol	Option
Nil	None
N	With silencer*

\* For AIR EXH: AN20-□02  
(□: Either Nil or N is entered as a thread symbol.)


**Port size**

Symbol	Port size	Applicable model	
		PA3000	PA5000
03	3/8"	●	—
04	1/2"	—	●
06	3/4"	—	●


**Made to order specifications**  
**X2** With air operated reset port



PA3□□0

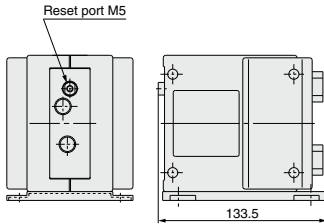

PA5□□0

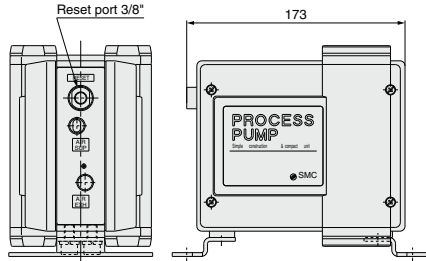

## 3. With Operating Cycle Counting Port

PA **3** **1** **1** **0** - **03** - **X8**

**Body size**

Symbol	Body size
3	3/8"
5	1/2"

**Wetted body material**

Symbol	Body material
1	ADC12 (Aluminum)
2	SCS14 (Stainless steel)

**Diaphragm material**

Symbol	Diaphragm material
1	PTFE
2	NBR

**Thread type**

Symbol	Type
Nil	Rc
N	NPT
F	G
T	NPTF

**Option**


Symbol	Option
Nil	None
N	With silencer*

**Made to order specifications**  
**X8** With Operating Cycle Counting Port


\* For AIR EXH: AN20-□02  
(□: Either Nil or N is entered as a thread symbol.)

**Port size**


Symbol	Port size	Applicable model	
		PA3000	PA5000
03	3/8"	●	—
04	1/2"	—	●
06	3/4"	—	●



PA3□□0

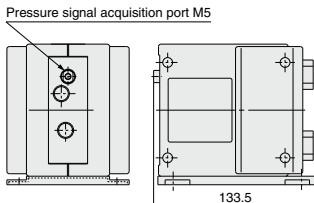

PA5□□0

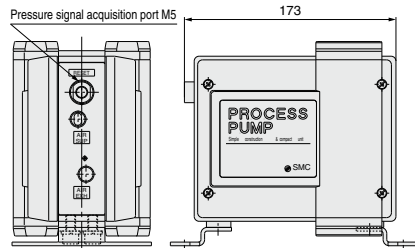

# Process Pump

## PA(P)3000 Series

Fluoro resin Type

RoHS

Body material made from New PFA  
for superior corrosion resistance.

PA

PA(P)

PAX

PB

PAF

PA


PB



# With the use of New PFA for body material,

Body material  
**New PFA**

Diaphragm  
material  
**PTFE**

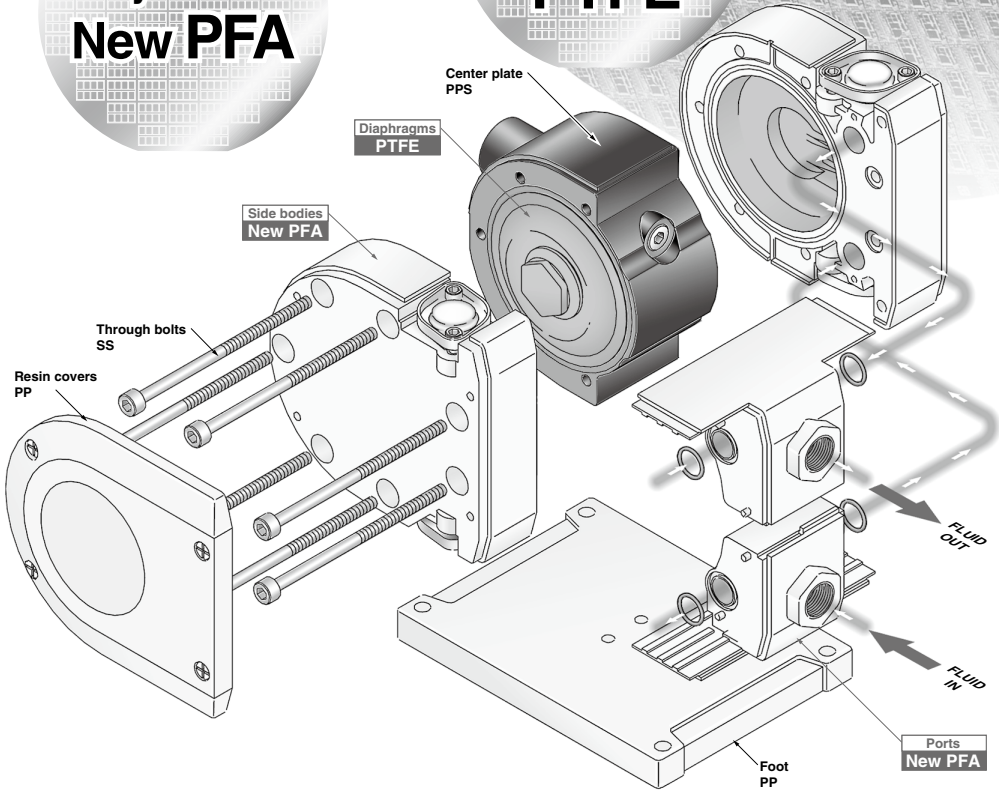


## Variations

	Model	Body material	Diaphragm material	Assembly environment	Discharge rate (L/min)	Option
Automatically operated type	PA3310	New PFA	PTFE	Standard	1 to 13*	•Foot •Silencer
	PAP3310			Clean room		
Air pilot operated type	PA3313			Standard	0.1 to 9	•Foot
	PAP3313			Clean room		

\*With 3/8" inlet/outlet tube: 1 to 12

# high corrosion resistance is achieved!

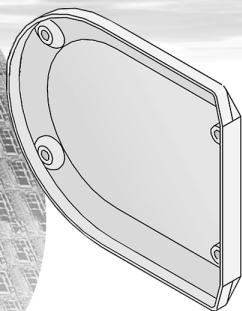

## Clean

You can order your process pump assembled in a **Clean room** environment and double-packaged (Order number PAP331□).

Side bodies and ports are **molded** to achieve a great reduction in dust generation.

PA

PA(P)

PAX

PB


PAF

PA□  
PB


## Air pilot actuation reset is now a standard feature.

When the pump is used in an environment where manual reset is not possible, designing a circuit as the one shown below allows the use of air pressure for reset purposes.

With the use of an air pilot actuation reset circuit, resetting can be done by releasing the air pressure after supplying it to the reset port.

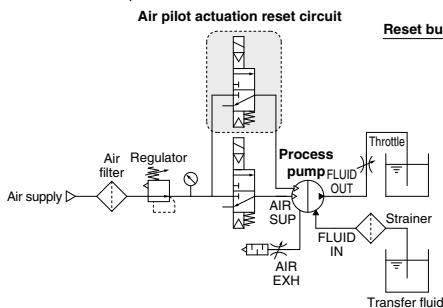

## Compact & Lightweight (Without foot)

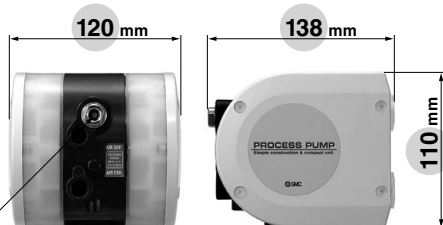


Weight: **2.1 kg**

## Air pilot actuation is standard.

External switching valve control makes constant cycling possible.

- **Discharge rate is easily controlled.**  
The flow rate can be easily adjusted by the number of ON/OFF cycles of the external solenoid valve.
- **Stable operation is possible in spite of such conditions as a minimal flow rate, low pressure operation, or the entrainment of gasses.**
- **Can be used for operation with repetitive stopping.**

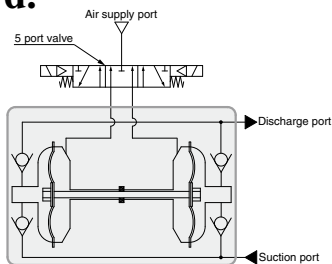

# Process Pump Clean Room Automatically Operated Type (Internal Switching Type) Air Operated Type (External Switching Type) **PA(P)3000 Series** RoHS

## How to Order

Female thread

PA **P** 331 **0** - **03** - **03** - **03**



**Actuation** Note 1)

Symbol	Actuation
0	Automatically operated
3	Air operated

**Thread type** Note 2)

Symbol	Type
Nil	Rc
N	NPT
F	G
T	NPTF

**Assembly environment**

Symbol	Assembly environment
Nil	Standard
P	Clean room

**Option**

Symbol	Option	Applicable actuation	
		Automatically operated	Air operated
Nil	None	●	●
B	With foot	●	●
N	With silencer **	●	—

\* When option is more than one, suffix in alphabetical order.  
\*\* For AIR EXH: AN20-□02  
(□: Either Nil or N is entered as a thread symbol.)

**Port size**

Symbol	Port size
03	3/8"

Tube extension

PAP331 **0** - **P** 13 **03** - **03** - **03**



**Actuation** Note 1)

Symbol	Actuation
0	Automatically operated
3	Air operated

**Assembly environment**

Symbol	Assembly environment
P	Clean room

**Tubing size**

Symbol	Main fluid connection size
11	3/8"
13	1/2"

**Option**

Symbol	Option	Applicable actuation	
		Automatically operated	Air operated
Nil	None	●	●
B	With foot	●	●
N	With silencer **	●	—

\* When option is more than one, suffix in alphabetical order.  
\*\* For AIR EXH: AN20-□02  
(□: Either Nil or N is entered as a thread symbol.)



**Thread type** Note 2)

Symbol	Type
Nil	Rc
N	NPT
F	G
T	NPTF

Note 1) The port size of the pilot port is 1/4".

Note 2) The thread type is applied to the pilot port thread and the female thread piping connection.

**Symbol**





# Process Pump Clean Room Automatically Operated Type/Air Operated Type **PA(P)3000 Series**

**With nut** PAP331 0 S-1 S 13 □ - □

**Assembly environment**

Symbol	Assembly environment
P	Clean room



**Actuation** Note 1)

Symbol	Actuation
0	Automatically operated
3	Air operated

**Fitting type**

Symbol	Fitting type
1	LQ1
2	LQ2

**Fitting size**

Symbol	IN side	OUT side
11	3	3
1113	3	4
1311	4	3
13	4	4
1319	4	5
1913	5	4
19	5	5

**Option**

Symbol	Option	Applicable actuation	
		Automatically operated	Air operated
Nil	None	●	●
B	With foot	●	●
N	With silencer **	●	—

\* When option is more than one, suffix in alphabetical order.

\*\* For AIR EXH: AN20-□02 (□: Either Nil or N is entered as a thread symbol.)

**Thread type** Note 2)

Symbol	Type
Nil	Rc
N	NPT
F	G
T	NPTF

PA

PA(P)

PAX

PB

PAF

PA□

PB

**Integrated fitting type** PAP331 0 -S 13 □ - □

**Assembly environment**

Symbol	Assembly environment
P	Clean room



**Actuation** Note 1)

Symbol	Actuation
0	Automatically operated
3	Air operated

**Fitting size**

Symbol	Fitting size
11	LQ2 3/8"
13	LQ2 1/2"

**Option**

Symbol	Option	Applicable actuation	
		Automatically operated	Air operated
Nil	None	●	●
B	With foot	●	●
N	With silencer **	●	—

\* When option is more than one, suffix in alphabetical order.

\*\* For AIR EXH: AN20-□02 (□: Either Nil or N is entered as a thread symbol.)

**Thread type** Note 2)

Symbol	Type
Nil	Rc
N	NPT
F	G
T	NPTF

Note 1) The port size of the pilot port is 1/4".

Note 2) The thread type is applied to the pilot port thread and the female thread piping connection.

Note 3) Refer to the pamphlet "High-Purity Fluoropolymer Fittings Hyper Fitting/LQ1, 2 series Work Procedure Instructions" (M-E05-1) for connecting tubing with special tools. (Downloadable from our website.)

# PA(P)3000 Series

## Specifications


Model		PA3310	PAP3310	PA3313	PAP3313
<b>Actuation</b>		Automatically operated		Air operated	
<b>Port size</b>	<b>Main fluid suction discharge port</b>	Rc, NPT, G, NPTF 3/8" Female thread	Rc, NPT, G, NPTF 3/8" Female thread 3/8", 1/2" Tube extension With nut (size 3, 4, 5) 3/8", 1/2" Integrated fitting type	Rc, NPT, G, NPTF 3/8" Female thread	Rc, NPT, G, NPTF 3/8" Female thread 3/8", 1/2" Tube extension With nut (size 3, 4, 5) 3/8", 1/2" Integrated fitting type
	<b>Pilot air supply/exhaust port</b>	Rc, NPT, G, NPTF 1/4" Female thread			
<b>Material</b>	<b>Body wetted areas</b>	New PFA			
	<b>Diaphragm</b>	PTFE			
	<b>Check valve</b>	PTFE, New PFA			
<b>Discharge rate</b>		1 to 13 L/min <sup>Note)</sup>		0.1 to 9 L/min	
<b>Average discharge pressure</b>		0 to 0.4 MPa			
<b>Pilot air pressure</b>		0.2 to 0.5 MPa			
<b>Pilot air consumption</b>		140 L/min (ANR) or less			
<b>Suction lifting range</b>	<b>Dry</b>	0.5 m (Interior of pump dry)			
	<b>Wet</b>	Up to 4 m (liquid inside pump)			
<b>Noise</b>		80 dB (A) or less (Option: with silencer, AN20)		75 dB (A) or less (excluding the noise from the quick exhaust and solenoid valve)	
<b>Withstand pressure</b>		0.75 MPa			
<b>Diaphragm life</b>		50 million times			
<b>Fluid temperature</b>		0 to 100°C (No freezing, heat cycle not applied)			
<b>Ambient temperature</b>		0 to 100°C (No freezing, heat cycle not applied)			
<b>Maximum viscosity</b>		1000 mPa·s			
<b>Recommended operating cycle</b>		—		2 to 4 Hz	
<b>Weight</b>		2.1 kg (without foot)			
<b>Mounting orientation</b>		Horizontal (with mounting foot at bottom)			
<b>Packaging</b>		General environment	Clean double packaging	General environment	Clean double packaging

\* Each value of above represents at normal temperatures with fresh water.

\* For related products, refer to pages 622 and 623

Note) The discharge rates for PAP3310-P11, PAP3310S-□S11, PAP3310S-□S1113, PAP3310S-□S1311, PAP3310S-111 are between 1 to 12 L/min.

## Maintenance Parts

 ● Basically, it is not recommended to disassemble the process pump. However, if this is necessary, be sure to follow the instructions in the maintenance procedure.

● When carrying out this work, wear appropriate protective equipment.

### PA(P)3000 Series


Description	PA(P)3000 series			
	PA3310	PA3313	PAP3310	PAP3313
<b>Diaphragm kit</b>	KT-PA3-531		KT-PAP3-531	
<b>Check valve kit</b>	KT-PA3-536#1		KT-PAP3-536#1	
<b>Pilot valve kit</b>	KT-PA3-538	—	KT-PA3-538	—
<b>Manual cap assembly kit</b>	KT-PA3-545 <sup>Note)</sup>	—	KT-PA3-545 <sup>Note)</sup>	—
<b>Foot kit</b>	KT-PA3-40		KT-PAP3-40	

\* The maintenance procedure is to be distributed individually. Please contact your SMC sales representative for details.


Note) One of Nil, N, F or T is entered as a thread symbol.

## Performance Curve: Automatically Operated Type

### PAP3310 Flow Rate Characteristics

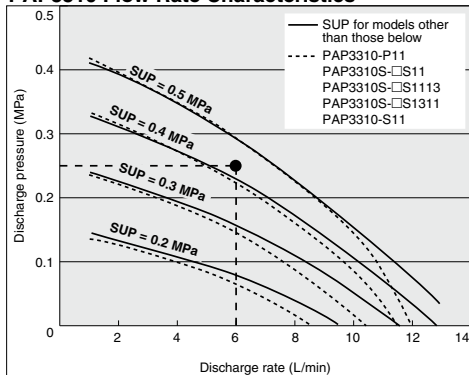

### PAP3310 Air Consumption

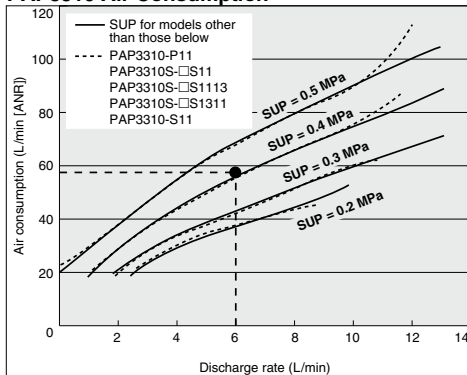

PA  
PA(P)  
PAX  
PB  
PAF  
PA□  
PB

### Selection from Flow Rate Characteristic Graph (PAP3310)

Required specifications example:

Find the pilot air pressure and pilot air consumption for a discharge rate of 6 L/min and a discharge pressure of 0.25 MPa. <The transfer fluid is fresh water (viscosity 1 mPa·s, specific gravity 1.0).

\* If the total lifting height is required instead of the discharge pressure, a discharge pressure of 0.1 MPa corresponds to a total lift of 10 m.


Selection procedures:

1. First mark the intersection point for a discharge rate of 6 L/min and a discharge pressure of 0.25 MPa.
2. Find the pilot air pressure for the marked point. In this case, the point is between the discharge curves (solid lines) for SUP = 0.4 MPa and SUP = 0.5 MPa, and based on the proportional relationship to these lines, the pilot air pressure for this point is approximately 0.43 MPa.
3. Next find the air consumption rate. Find the intersection point for a discharge rate of 6 L/min and a discharge curve (solid line) for SUP = 0.43 MPa. Draw a line from this point to the Y axis to determine the air consumption rate. The result should be approx. 58 L/min (ANR).

### ⚠ Caution

1. These flow rate characteristics are for fresh water (viscosity 1 mPa·s, specific gravity 1.0).
2. The discharge rate differs greatly depending on properties (viscosity, specific gravity) of the fluid being transferred and operating conditions (lifting range, transfer distance), etc.
3. Use 0.75 kW per 100 L/min of air consumption as a guide for the relationship of the air consumption to the compressor.

### Viscosity Characteristics (Flow rate correction for viscous fluids)

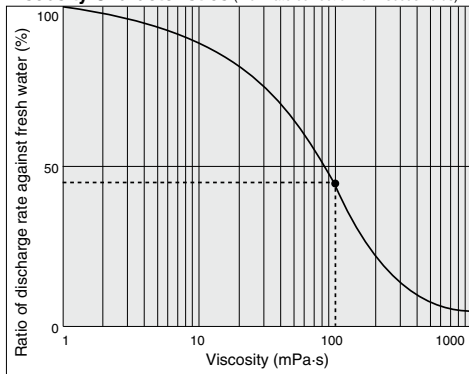

### Selection from Viscosity Characteristic Graph

Required specifications example:

Find the pilot air pressure and pilot air consumption for a discharge rate of 2.7 L/min, and a viscosity of 100 mPa·s.

Selection procedures:

1. First find the ratio of the discharge rate for fresh water when viscosity is 100 mPa·s from the graph below. It is determined to be 45%.
2. Next, in the required specification example, the viscosity is 100 mPa·s and the discharge rate is 2.7 L/min. Since this is equivalent to 45% of the discharge rate for fresh water,  $2.7 \text{ L/min} \div 0.45 = 6 \text{ L/min}$ , indicating that a discharge rate of 6 L/min is required for fresh water.
3. Finally, find the pilot air pressure and pilot air consumption based on selection from the flow characteristic graphs.

### ⚠ Caution

Viscosities up to 1000 mPa·s can be used.  
Dynamic viscosity  $\nu = \text{Viscosity } \mu / \text{Density } \rho$ .


$$\nu = \frac{\mu}{\rho}$$

$$\nu (10^{-3} \text{ m}^2/\text{s}) = \mu (\text{mPa}\cdot\text{s}) / \rho (\text{kg}/\text{m}^3)$$


# PA(P)3000 Series

## Performance Curve: Air Operated Type


### PAP3313 Flow Rate Characteristics

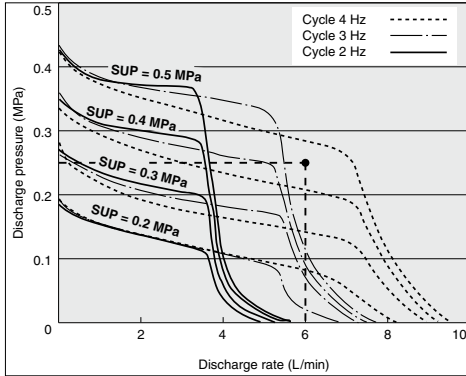


### PAP3313 Air Consumption (2 Hz)

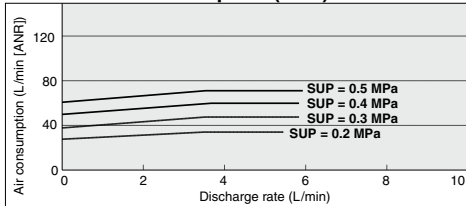

### PAP3313 Air Consumption (3 Hz)

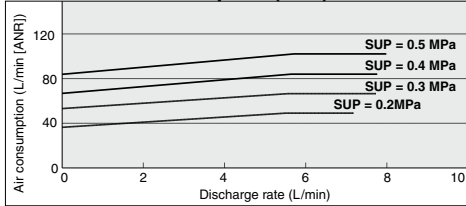

### Viscosity Characteristics (Flow rate correction for viscous fluids)

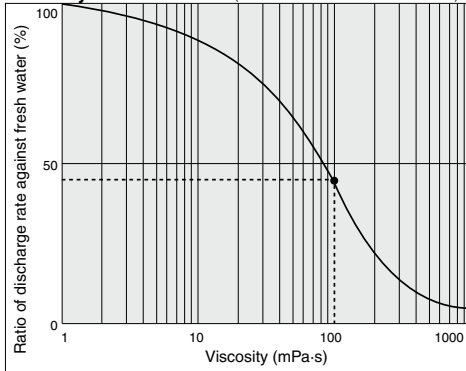

### Selection from Flow Rate Characteristic Graph (PAP3313)


Required specification example: Find the pilot air pressure for a discharge rate of 6 L/min, a discharge pressure of 0.25 MPa, and a cycle of 4 Hz. <The transfer fluid is fresh water (viscosity 1 mPa-s, specific gravity 1.0).>

Note) If the total lifting height is required instead of the discharge pressure, a discharge pressure of 0.1 MPa corresponds to a total lift of 10 m.

Selection procedures:

1. First mark the intersection point for a discharge rate of 6 L/min and a discharge pressure of 0.25 MPa.
2. Find the pilot air pressure for the marked point. In this case, the point is between the discharge curves (solid lines) for SUP = 0.4 MPa and SUP = 0.5 MPa, and based on the proportional relationship to these lines, the pilot air pressure for this point is approximately 0.45 MPa.

### PAP3313 Air Consumption (4 Hz)

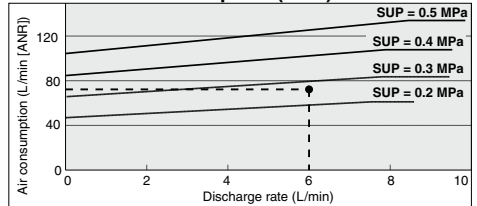

### Calculating Air Consumption (PAP3313)

Required specifications example:

Find the pilot air consumption for a discharge rate of 6 L/min, a cycle of 4 Hz and a pilot air pressure of 0.25 MPa.

Selection procedures:

1. In the graph for air consumption (4 Hz), start at a discharge rate of 6 L/min.
2. Mark where this point intersects with the air consumption rate. Based on the proportional relationship between these lines, the intersection point will be between the discharge curves SUP = 0.2 MPa and SUP = 0.3 MPa.
3. From the point just found, draw a line to the Y-axis to find the air consumption. The result is approximately 70 L/min (ANR).

### ⚠ Caution

1. These flow rate characteristics are for fresh water (viscosity 1 mPa-s, specific gravity 1.0).
2. The discharge rate differs greatly depending on properties (viscosity, specific gravity) of the fluid being transferred and operating conditions (density, lifting range, transfer distance).

### Selection from Viscosity Characteristic Graph

Required specification example: Find the pilot air pressure for a discharge rate of 2.7 L/min, discharge pressure of 0.25 MPa and a viscosity of 100 mPa-s.

Selection procedures:

1. First find the ratio of the discharge rate for fresh water when viscosity is 100 mPa-s from the graph below. It is determined to be 45%.
2. Next, in the required specification example, the viscosity is 100m Pa-s and the discharge rate is 2.7 L/min. Since this is equivalent to 45% of the discharge rate for fresh water,  $2.7 \text{ L/min} \div 0.45 = 6 \text{ L/min}$ , indicating that a discharge rate of 6 L/min is required for fresh water.
3. Finally, find the pilot air pressure and pilot air consumption based on selection from the flow characteristic graphs.

### ⚠ Caution

Viscosities up to 1000 mPa-s can be used.


Dynamic viscosity  $v = \text{Viscosity } \mu / \text{Density } \rho$ .

$$v = \frac{\mu}{\rho}$$


$$v(10^{-3} \text{ m}^2/\text{s}) = \mu(\text{mPa-s}) / \rho(\text{kg}/\text{m}^3)$$

**Dimensions**


**PAP3310/Automatically Operated Type**

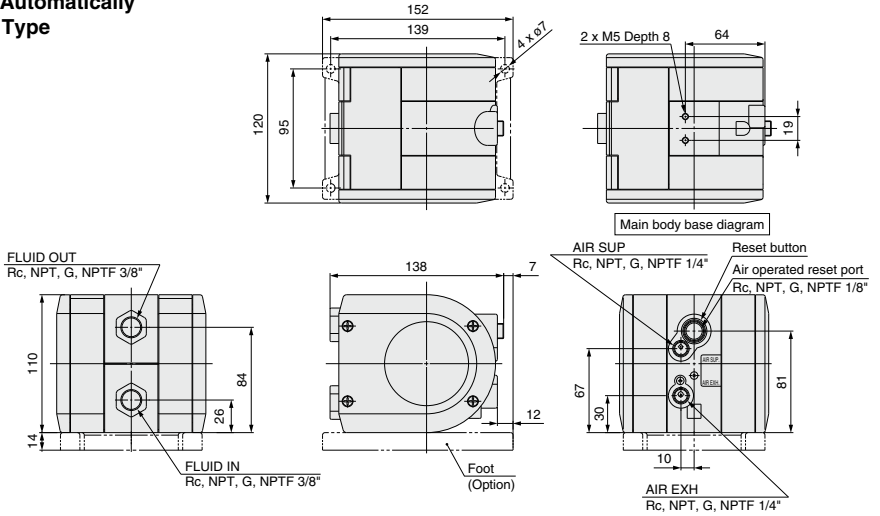


**PAP3313/Air Operated Type**

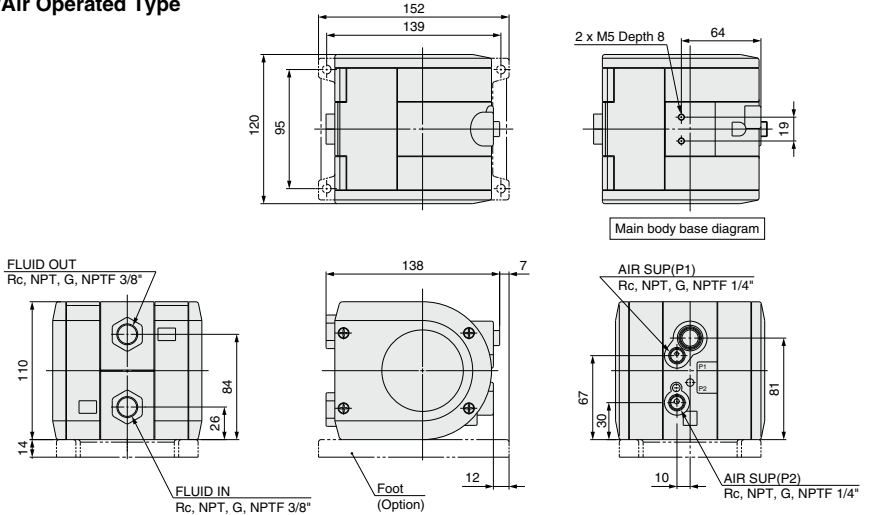


**Integrated fitting type**



**With nut**



**Tube extension**



PA
PA(P)
PAX
PB
PAF
PA <input type="checkbox"/>
PB <input type="checkbox"/>

# Process Pump

## PAX1000 Series


Automatically Operated Type, Built-in Pulsation Attenuator (Internal Switching Type)

RoHS



### ■ Prevents spraying of discharge and foaming in tank


- Space-saving design eliminates separate piping with built-in pulsation attenuator

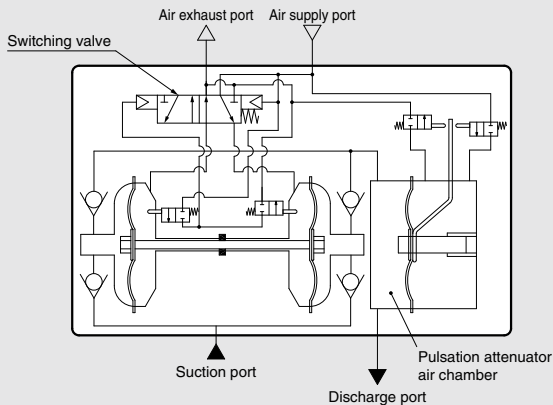

# Process Pump Automatically Operated Type, Built-in Pulsation Attenuator (Internal Switching Type)

## PAX1000 Series RoHS

### How to Order



PAX1 1 1 2 -   02 -  

#### Body material

Symbol	Body material
1	ADC12 (Aluminum)
2	SCS14 (Stainless steel)

#### Actuation

Symbol	Actuation
2	Automatically operated type built-in pulsation attenuator

#### Option

Symbol	Option
Nil	Body only
N	With silencer *

\* For AIR EXH: AN20-02  
(□: Either Nil or N is entered as a thread symbol.)

#### Port size

Symbol	Port size
02	1/4"
03	3/8"

#### Thread type

Symbol	Type
Nil	Rc
N	NPT
F	G
T	NPTF

### Specifications

Model		PAX1112	PAX1212
<b>Actuation</b>		Automatic operation	
<b>Port size</b>	<b>Main fluid suction discharge port</b>	Rc, NPT, G, NPTF 1/4", 3/8" Female thread	
	<b>Pilot air supply/exhaust port</b>	Rc, NPT, G, NPTF 1/4" Female thread	
<b>Material</b>	<b>Body wetted areas</b>	ADC12	SCS14
	<b>Diaphragm</b>	PTFE	
	<b>Check valve</b>	PTFE, SCS14	
<b>Discharge rate</b>		0.5 to 10 L/min	
<b>Average discharge pressure</b>		0 to 0.6 MPa	
<b>Pilot air pressure</b>		0.2 to 0.7 MPa	
<b>Air consumption</b>		Max. 150 L/min (ANR)	
<b>Suction lifting range</b>	<b>Dry</b>	Up to 2 m (Interior of pump dry)	
	<b>Wet</b>	Up to 6 m (Liquid inside pump)	
<b>Noise</b>		84 dB(A) or less (Option: with silencer, AN20)	
<b>Withstand pressure</b>		1.05 MPa	
<b>Diaphragm life</b>		50 million cycles (For water)	
<b>Fluid temperature</b>		0 to 60°C (No freezing)	
<b>Ambient temperature</b>		0 to 60°C (No freezing)	
<b>Maximum viscosity</b>		1000 mPa·s	
<b>Weight</b>		2.0 kg	3.5 kg
<b>Mounting position</b>		Horizontal (Bottom facing down)	
<b>Packaging</b>		General environment	


\* Each of the values above are for normal temperatures and when the transferred fluid is fresh water.  
\* Refer to page 577 for maintenance parts.  
\* Refer to pages 622 and 623 for related products.

PA  
PA(P)  
PAX  
PB  
PAF  
PA□  
PB

# PAX1000 Series

## Performance Curve: Automatically Operated Type, Built-in Pulsation Attenuator

### PAX1000 Flow Rate Characteristics

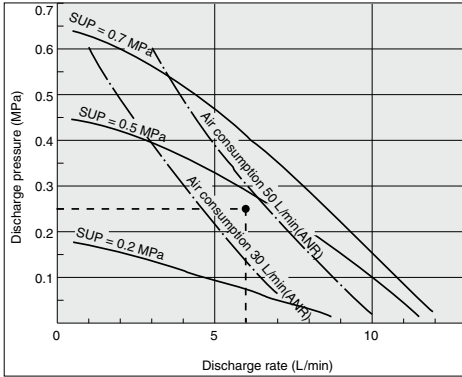

### Selection from Flow Rate Characteristic Graph

Required specification example:

Find the pilot air pressure and pilot air consumption for a discharge rate of 6 L/min and a discharge pressure of 0.25 MPa. <The transfer fluid is fresh water (viscosity 1 mPa·s, specific gravity 1.0).>


\* If the total lifting height is required instead of the discharge pressure, a discharge pressure of 0.1 MPa corresponds to a total lift of 10 m.

1. First mark the intersection point for a discharge rate of 6 L/min and a discharge pressure of 0.25 MPa.
2. Find the pilot air pressure for the marked point. In this case, the point is between the discharge curves (solid lines) for SUP = 0.2 MPa and SUP = 0.5 MPa, and based on the proportional relationship to these lines, the pilot air pressure for this point is approximately 0.45 MPa.
3. Next find the air consumption. Since the marked point is below the curve for 50 L/min (ANR), the maximum rate will be about 45 L/min (ANR).

### ⚠ Caution

1. These flow rate characteristics are for fresh water (viscosity 1 mPa·s, specific gravity 1.0).
2. The discharge rate differs greatly depending on properties (viscosity, specific gravity) of the fluid being transferred and operating conditions (lifting range, transfer distance), etc.
3. Use 0.75 kW per 100 L/min of air consumption as a guide for the relationship of the air consumption to the compressor.

### Viscosity Characteristics (Flow rate correction for viscous fluids)

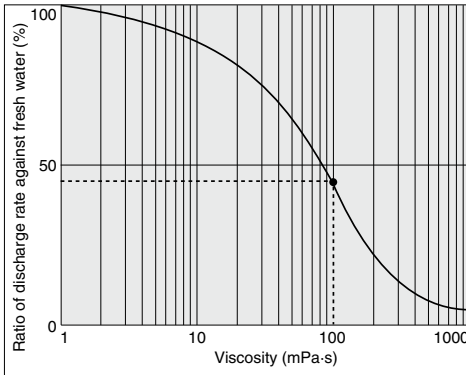

### Selection from Viscosity Characteristic Graph

Required specification example:

Find the pilot air pressure and pilot air consumption for a discharge rate of 2.7 L/min, a discharge pressure of 0.25 MPa, and a viscosity of 100 mPa·s.

Selection procedures

1. First find the ratio of the discharge rate for fresh water when viscosity is 100 mPa·s from the graph below. It is determined to be 45%.
2. Next, in the required specification example, the viscosity is 100 mPa·s and the discharge rate is 2.7 L/min. Since this is equivalent to 45% of the discharge rate for fresh water,  $2.7 \text{ L/min} \div 0.45 = 6 \text{ L/min}$ , indicating that a discharge rate of 6 L/min is required for fresh water.
3. Finally, find the pilot air pressure and pilot air consumption based on selection from the flow characteristic graphs.

### ⚠ Caution



Viscosities up to 1000 mPa·s can be used.

Dynamic viscosity  $\nu$  = Viscosity  $\mu$ /Density  $\rho$ .

$$\nu = \frac{\mu}{\rho}$$

$$\nu(10^{-3}\text{m}^2/\text{s}) = \mu(\text{mPa}\cdot\text{s})/\rho(\text{kg}/\text{m}^3)$$


### Pulsation Attenuating Capacity

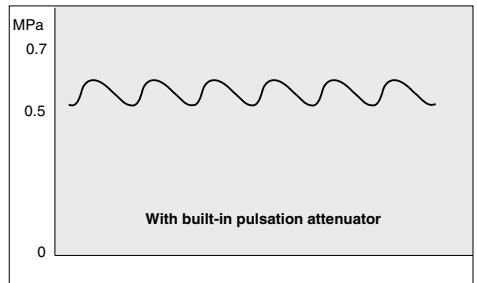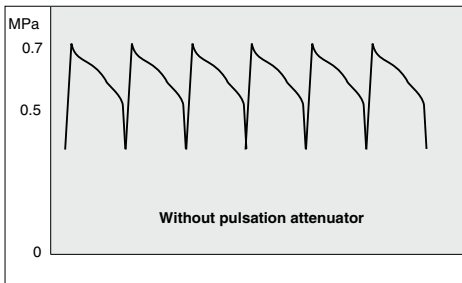

The process pump generates pulsation because it discharges a liquid using two diaphragms. The pulsation attenuator absorbs pressure when discharge pressure increases, and compensates the pressure when discharge pressure decreases. By this means pulsation is controlled.



## Working Principle: Automatically Operated Type, Built-in Pulsation Attenuator

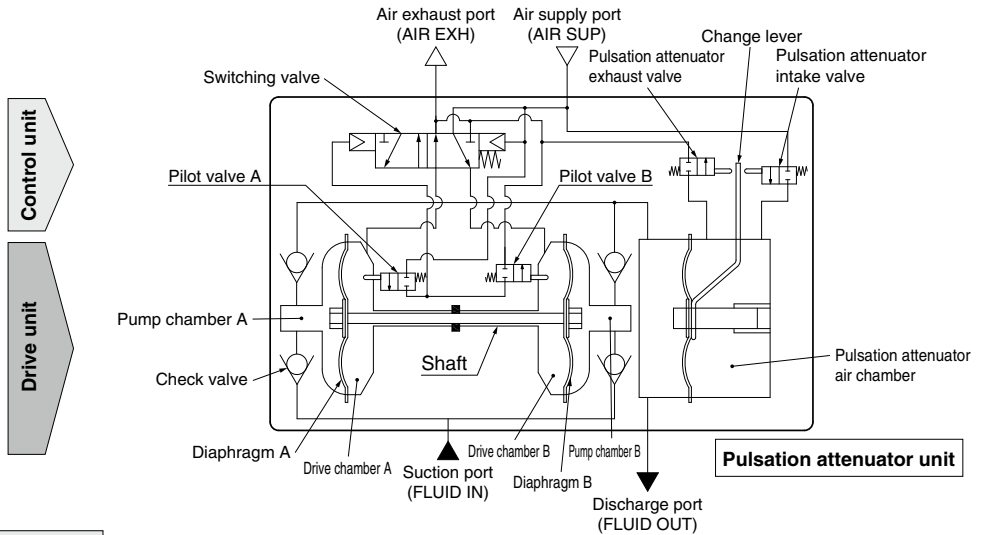

PA
PA(P)
<b>PAX</b>
PB
PAF
PA□
PB

### Control unit

1. When air is supplied, it passes through the switching valve and enters drive chamber B.
2. Diaphragm B moves to the right, and at the same time diaphragm A also moves to the right pushing pilot valve A.
3. When pilot valve A is pushed, air acts upon the switching valve, drive chamber A switches to a supply state, and the air which was in drive chamber B is exhausted to the outside.
4. When air enters drive chamber A, diaphragm B moves to the left pushing pilot valve B.
5. When pilot valve B is pushed, the air which was acting upon the switching valve is exhausted, and drive chamber B once again switches to a supply state. A continuous reciprocal motion is generated by this repetition.

### Drive unit

1. When air enters drive chamber B, the fluid in pump chamber B is forced out, and at the same time fluid is sucked into pump chamber A.
2. When the diaphragm moves in the opposite direction, the fluid in pump chamber A is forced out, and fluid is sucked into pump chamber B.
3. The pressure of the fluid that is forced out of the pump chamber is adjusted in the pulsation attenuation chamber and is then exhausted.
4. Continuous suction/discharge is performed by the reciprocal motion of the diaphragm.

### Pulsation attenuation chamber

1. Pulsation is attenuated by the elastic force of the diaphragm and air in the pulsation attenuation chamber.
2. When the pressure in the pulsation attenuation chamber rises, the change lever presses the pulsation attenuator intake valve, and air enters the pulsation attenuator air chamber.
3. Conversely, when pressure drops, the change lever presses the pulsation attenuator exhaust valve, exhausting the air from the air chamber and keeping the diaphragm in a constant position. Note that some time is required for the pulsation attenuator to operate normally.

## Maintenance Parts

- ⚠️ Basically, it is not recommended to disassemble the process pump. However, if this is necessary, be sure to follow the instructions in the maintenance procedure.
- When carrying out this work, wear appropriate protective equipment.


### PAX1000 Series

Description	PAX1000 series
	PAX1□12
Diaphragm kit	KT-PAX1-31
Check valve kit	KT-PAX1-36
Switching valve parts kit	KT-PAX1-37#1
Pilot valve kit	KT-PA5-38
Pulsation attenuator control valve kit	KT-PAX1-39

# PAX1000 Series

## Piping: Automatically Operated Type, Built-in Pulsation Attenuator

### Piping diagram

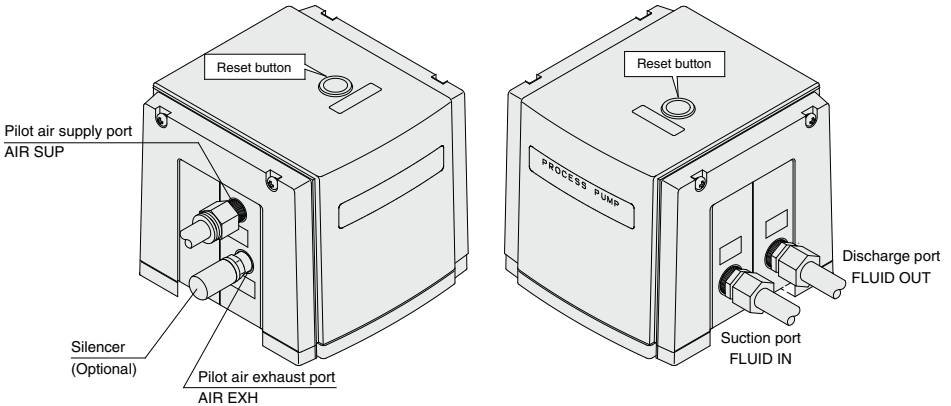

### ⚠ Caution

Mounting posture of the pump is set with the bottom surface at the bottom. Air to be supplied to the AIR SUP port should be cleaned and filtered through AF filter, etc. Air with foreign matter or drainage etc. will have negative effects on the built-in switching valve and will lead to malfunction. When air needs additional purification, use a filter (AF series), and a mist separator (AM series) together. Maintain the proper tightening torque for fittings and mounting bolts, etc. Looseness can cause problems such as fluid and air leaks, while over tightening can cause damage to threads and parts, etc.

### Operation

<Starting and Stopping> Refer to circuit example (1)

1. Connect air piping to the air supply port <AIR SUP> and connect piping for the fluid to be transferred to the suction port <FLUID IN> and the discharge port <FLUID OUT>.
2. Using a regulator, set the pilot air pressure within the range of 0.2 to 0.7 MPa. Then, the pump operates when power is applied to the 3 port solenoid valve of the air supply port <AIR SUP>, the sound of exhaust begins from the air exhaust port <AIR EXH> and fluid flows from the suction port <FLUID IN> to the discharge port <FLUID OUT>. At this time, the throttle on the discharge side is in an open state. The pump performs suction with its own power even without priming. (Dry state suction lifting range: max. 2 m) To restrict exhaust noise, attach a silencer (AN20-02: option) to the air exhaust port <AIR EXH>.
3. To stop the pump, exhaust the air pressure being supplied to the pump by the 3 port solenoid valve of the air supply port <AIR SUP>. The pump will also stop if the throttle on the discharge side is closed.


<Discharge Flow Rate Adjustment>

1. To adjust the flow rate from the discharge port <FLUID OUT>, use the throttle connected to the discharge side. Refer to circuit example (1). Note that this product cannot be used as a fixed quantity liquid dispense pump.
2. When operating with a discharge flow rate below the specification range, provide a by-pass circuit from the discharge side to the suction side to ensure the minimum flow rate inside the process pump. With a discharge flow rate below the minimum flow rate, the process pump may stop due to unstable operation. Refer to circuit example (2). (Minimum flow rates: PAX1000 0.5 L/min)

<Reset Button>

1. When the pump stops during operation, press the reset button. This makes it possible to restore operation in case the switching valve becomes clogged due to foreign matter in the supply air. Maintenance is necessary if the reset button needs to be pressed frequently.

### Circuit example (1)

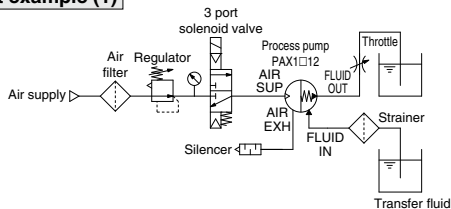

**Dimensions**

PA
PA(P)
<b>PAX</b>
PB
PAF
PA <input type="checkbox"/>
PB <input type="checkbox"/>

