




SD 01C25R10-02E

Unit: mm (approx. inch)


● EJX910A [Style: S2]

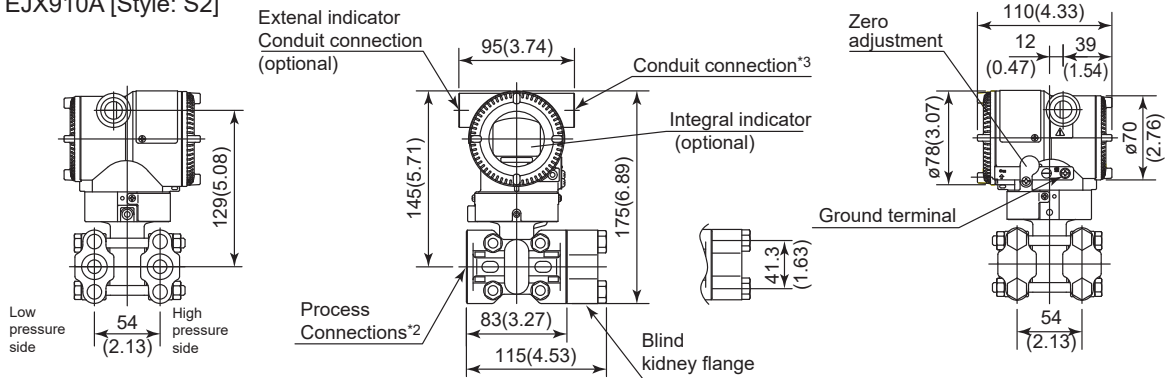


● EJX930A [Style: S1]

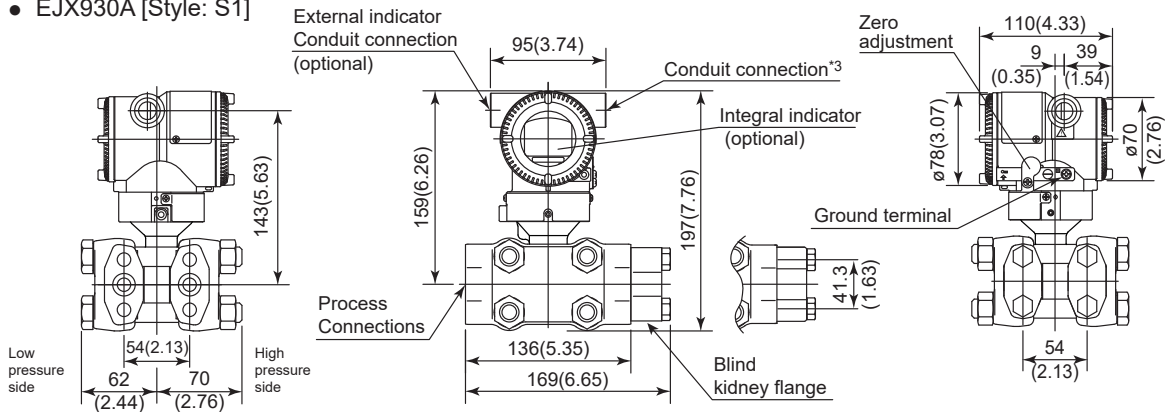


Electrical connection code 9
External temp. input code 0



Electrical connection code 2
External temp. input code 1, 2, 3, and 4



Electrical connection code 4
External temp. input code 1, 2, 3, and 4



Electrical connection code 2 and 4
External temp. input code B, C, and D


*1: When electrical connection code 7 or C is selected, a blind plug is protruded up to 8 mm from the conduit connection.

*2: When option code BS is selected, a bug screen is attached in the process connection port on the cover flange of low pressure side.


*3: When option code PP is selected, a blind plug is attached to the conduit connection on both sides.

- Terminal Configuration

RTD cable connection

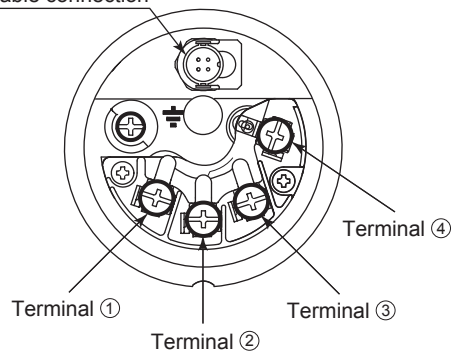


- Terminal Wiring
(HART and FOUNDATION Fieldbus protocol types)

SUPPLY	+	①] Power supply and output terminals
	-	②	
CHECK	+	③] External indicator (ammeter) terminals *1*2
	-	②	
PULSE	+	④] Pulse or status contact output terminals *2
	-	②	
			Ground terminal

*1: When using an external indicator or check meter, the internal resistance must be 10Ω or less.

*2: Not available for FOUNDATION Fieldbus communication type.

- Terminal Wiring
(Modbus protocol type)

SUPPLY	+	①] Power supply terminals
	-	②	
MODBUS	A	③] Modbus communication (RS-485) terminals
	B	④	
			Ground terminal